



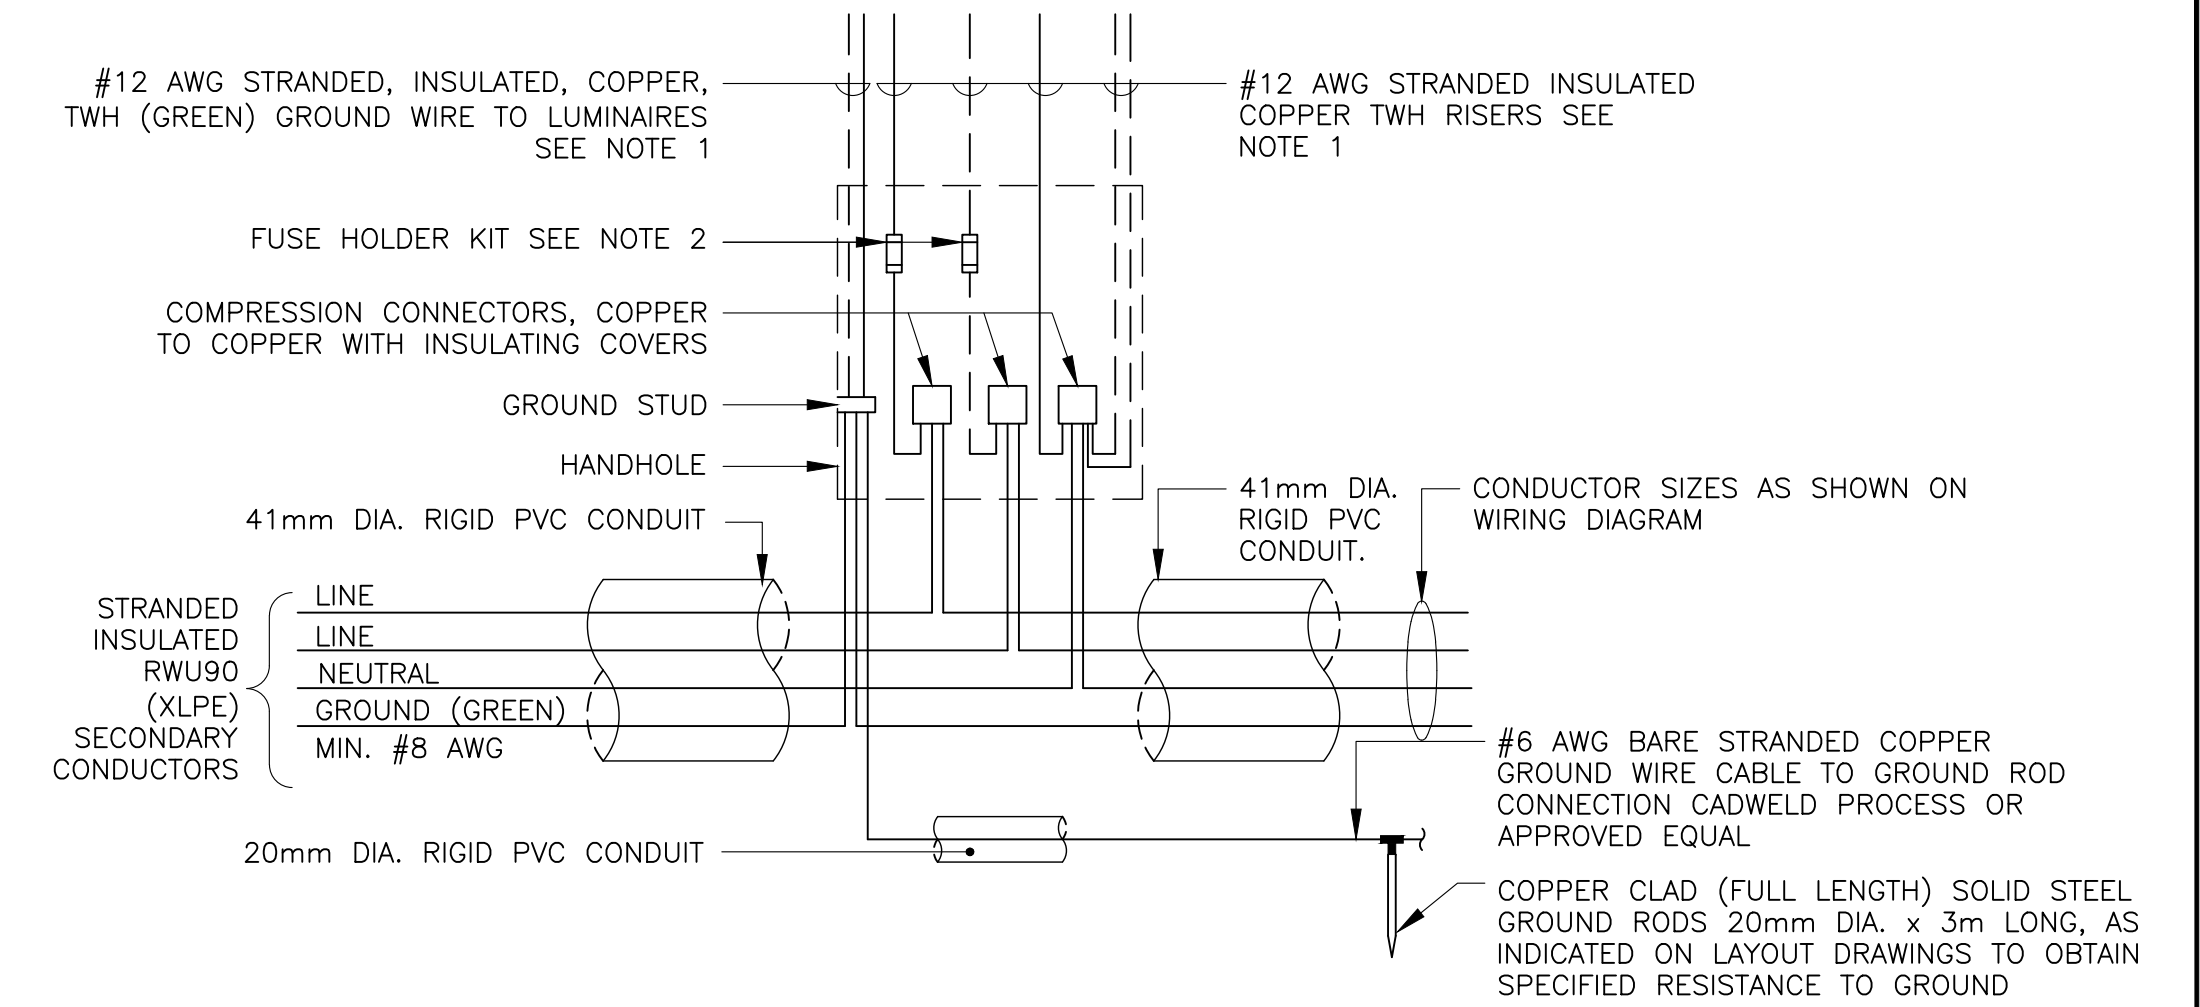

120/208 VOLT, 1 PHASE SYSTEM

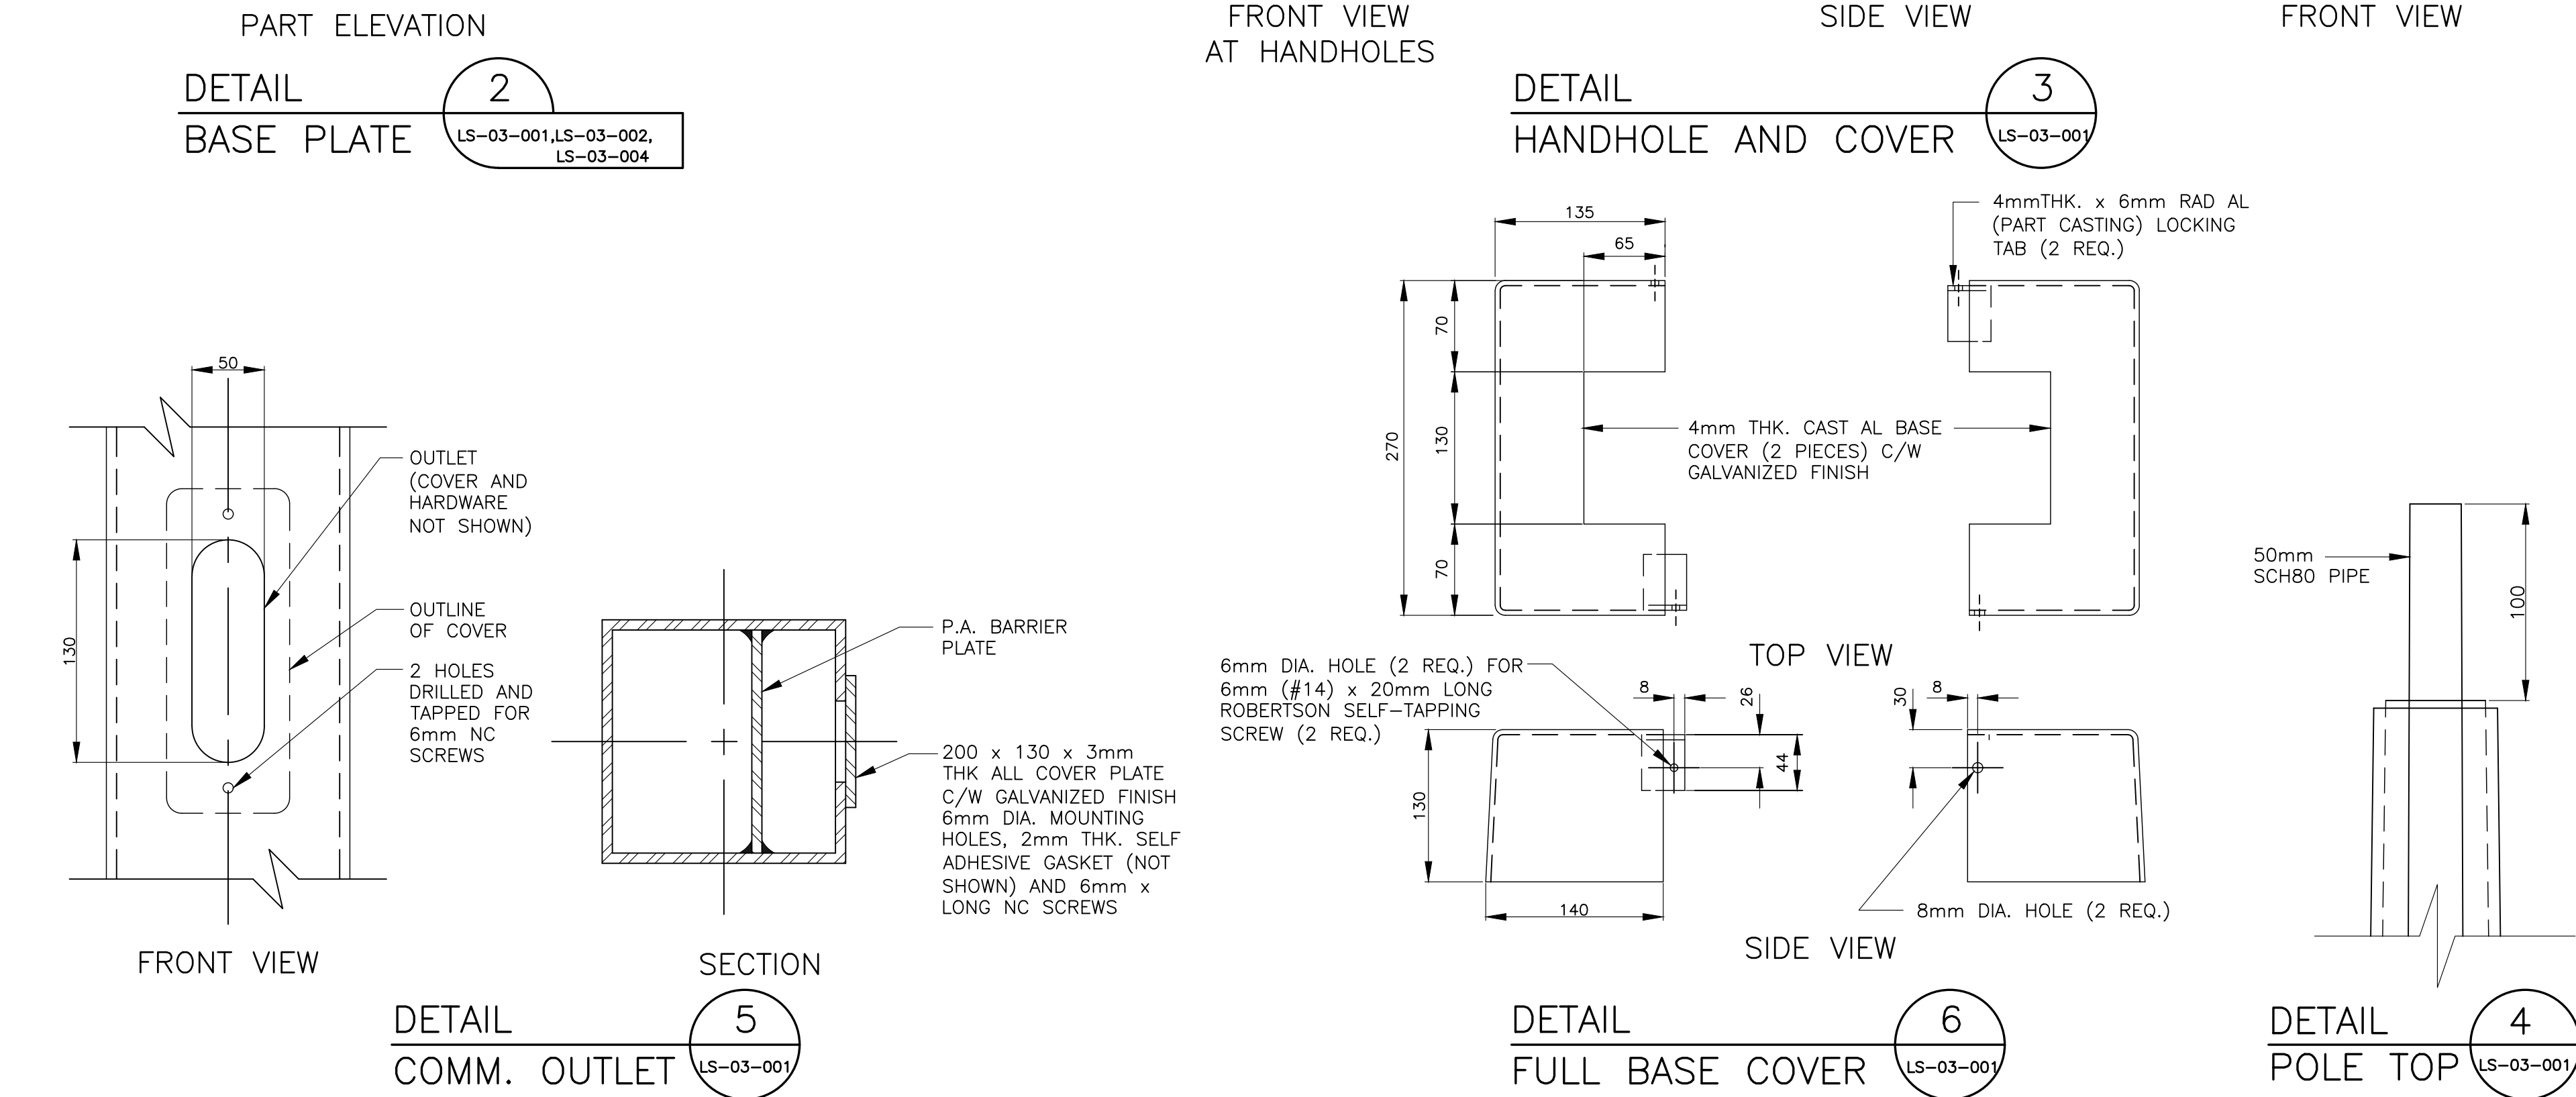

120/208 VOLT, 3 PHASE SYSTEM

- NOTES:**
1. BROKEN LINES INDICATE ADDITIONAL CONDUCTORS FOR DOUBLE LUMINAIRE INSTALLATION AND / OR ALTERNATE CIRCUIT IN ACCORDANCE WITH PLATFORM LIGHTING AND WIRING DIAGRAM DRAWINGS.
 2. IN-LINE WATERPROOF FUSEHOLDER 600V, 30A WITH BREAKAWAY FEATURE. GOULD GEB-11-11 C/W WATERPROOF INSULATING BOOTS AND ONE 10 AMP FUSE TYPE KTK 600 VOLTS OR APPROVED EQUAL.
 3. ALL GROUNDING WIRES TO BE FITTED WITH COMPRESSION LUGS BEFORE SECURING TO GROUND STUD IN POLE.
 4. ALL NUTS & BOLTS TO BE STAINLESS STEEL.

NOTE:
THIS DRAWING IS PROVIDED FOR INSTRUCTIONAL DESIGN PURPOSES ONLY BASED ON METROLINX GO TRANSIT DESIGN GUIDELINES AND REQUIREMENTS. THE CONSULTANT SHALL VERIFY FOR LOCAL CODE COMPLIANCE, EXISTING SITE CONDITIONS AND INTER DISCIPLINARY DRAWING COORDINATION. ALL DIMENSIONS AND SPECIFICATIONS SHOULD BE VERIFIED BY CONSULTANT AND/OR CONTRACTOR BEFORE ACTUAL CONSTRUCTION BEGINS.

AutoCAD drawing: LS-03-002.dwg	REFERENCE DRAWINGS		ISSUE			REVISIONS			DRAWN BY: X.X.X. YY/MM/DD	DESIGNED BY: X.X.X. YY/MM/DD				FACILITY 3m LIGHT POLE BASE PLATE, COVERS AND WIRING DETAILS			
									CHECKED BY: X.X.X. YY/MM/DD	APPROVED BY: X.X.X. YY/MM/DD							
									SCALE: N.T.S. FULL SIZE ONLY								
						0	18/04/XX										
DWG NO.	TITLE		REV.	DATE	ISSUED FOR	REV.	DATE						A Division of METROLINX	CONTRACT NO.	DWG. NO. LS-03-002	REV. 0	SHEET X/XX