


## METRIC

ALL DIMENSIONS SHOWN ARE  
IN METRES AND/OR MILLIMETRES  
UNLESS OTHERWISE NOTED.


GENERAL NOTES:

3. THIS TYPICAL 6m STRAIGHT SQUARE GALVANIZED STEEL POLE ASSEMBLY IS GENERAL GUIDANCE FOR ELECTRICAL INSTALLATION APPLICABLE TO PLATFORM, BUS LOADING, KISS & RIDE AND WALKWAY AREA LIGHTING. FOR CONCRETE FOUNDATION REQUIREMENT, REFER TO LAYOUT DRAWINGS AND CONCRETE FOUNDATION REINFORCEMENT TABLE ON STANDARD DRAWING LS 06H-004.
2. FOR APPLICABLE LUMINAIRE MOUNTING HEIGHTS SEE NOTE 1 ABOVE.
3. THE HORIZONTAL AND VERTICAL TRACK CLEARANCES FOR ALL PLATFORM LIGHTING POLE INSTALLATIONS SHALL COMPLY WITH THE LATEST CANADIAN NATIONAL AND/OR CANADIAN PACIFIC RAILWAYS STANDARD CLEARANCE DIAGRAM. THE DESIGNER TO DETERMINE EXACT DISTANCE AND MUST OBTAIN WRITTEN APPROVALS BEFORE ANY WORK IS STARTED.
4. SECOND LUMINAIRE IS USUALLY NECESSARY FOR CENTRE PLATFORM LIGHTING OR AS DETERMINED BY SITE CONDITIONS; REFER TO LAYOUT DRAWINGS.
5. LUMINAIRE MATERIAL AND FINISH AS PER SPECIFICATION. COLOR TO BE PLATINUM SILVER. LUMINAIRE MANUFACTURE TO SUPPLY VERTICAL SPLIT FILTER MOUNTS.
6. COMMUNICATION HARDWARE AND WIRING SUPPLIED AND INSTALLED AS SPECIFIED. FOR EXACT LOCATION OF SPEAKER, REFER TO LAYOUT DRAWINGS.
7. GROUNDING RODS TO BE LOCATED AT BASE OF EVERY OTHER POLE OR EVERY 50m (PLATFORM ONLY.)
8. ORIENTATE POLE SUCH THAT POLE SWING PARALLEL TO TRACK.
9. LIGHTING POLE CONSTRUCTION AND COMPONENTS SHALL BE HOT DIP GALVANIZED STEEL C.S.A. G40.21-44 W MINIMUM WITH 50Ksi YIELD
10. SEE ELECTRICAL SPECIFICATIONS FOR ALL WELDING, WIND SPEED AND EPA STANDARDS.
11. ALL FASTENERS TO BE STAINLESS STEEL EXCEPT WHERE NOTED OTHERWISE.
12. POLE MANUFACTURER SHALL SUPPLY BOLTS, NUTS AND WASHERS TO TO SUIT DESIGN SPECIFIED IN NOTE 10 ABOVE.
13. SEE DRAWING LS 06H-004 FOR POLE CONCRETE FOUNDATION DETAIL.
14. EQUIPMENT SHALL BE FIELD EVALUATED AND CERTIFIED AS APPROVED FOR USE BEFORE INSTALLATION.
15. NUTS AND BOLTS TO BE STAINLESS STEEL.
16. ALL EXPOSED CONDUIT FEEDING DEVICES TO ENCLOSURES SHALL HAVE DRIP LOOPS.
17. NEMA ENCLOSURES SHALL BE MOUNTED ONTO POST WITH STAINLESS BANDING STRAPS. DRILLING THE POST IS NOT ALLOWED.
18. DIGITAL SIGNAGE ON HINGED POLE IS NOT ALLOWED. STATIC SIGNAGE ONLY.

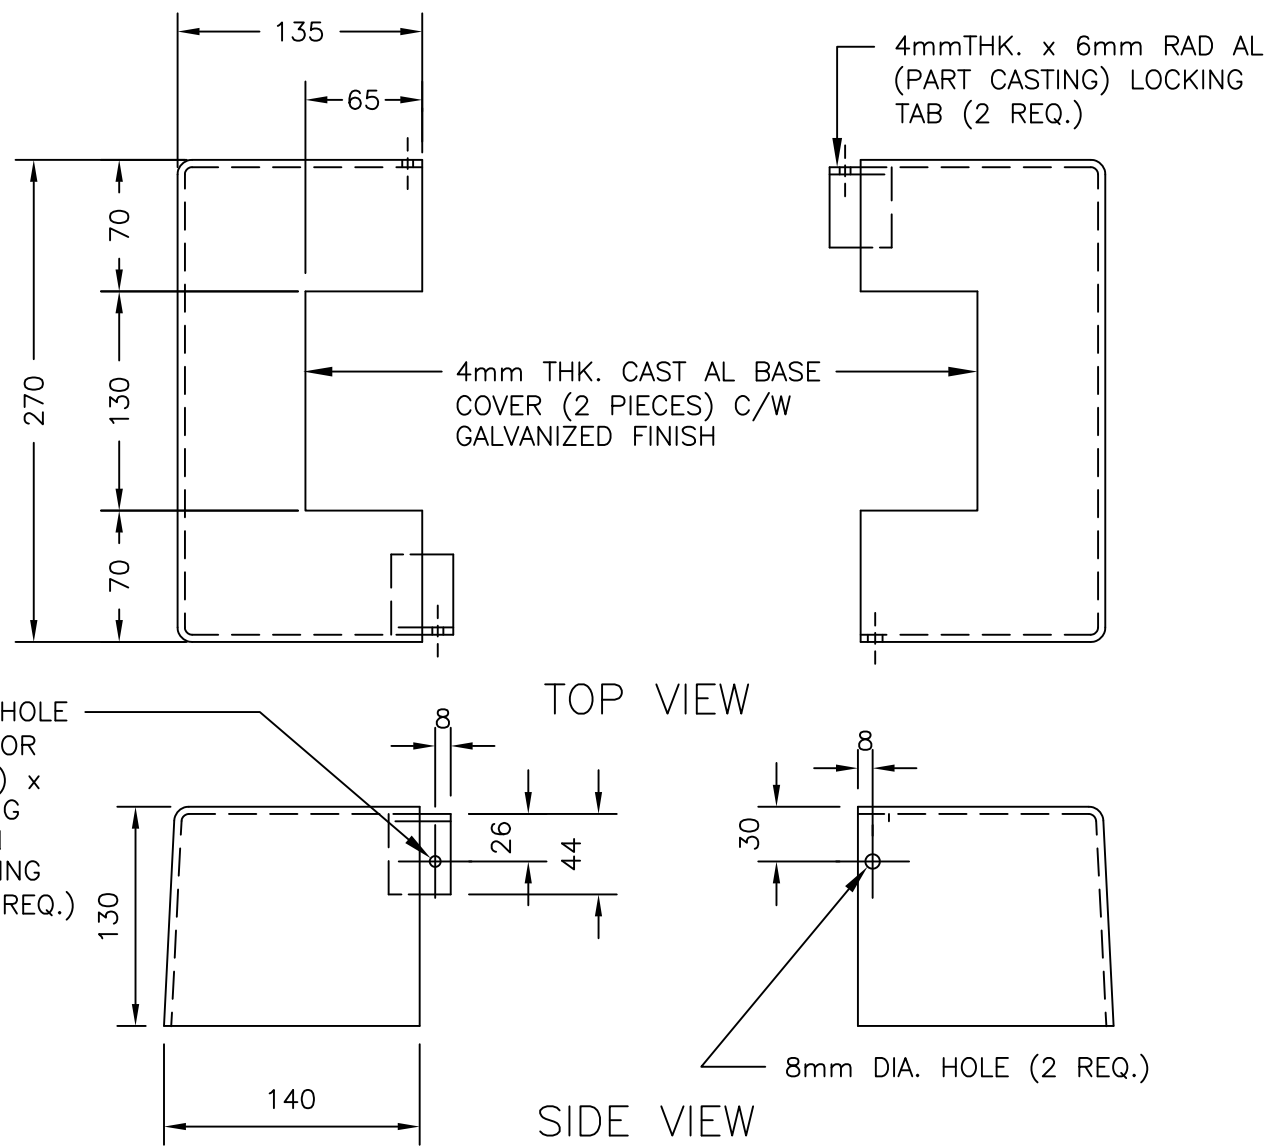


DETAIL	6
FULL BASE COVER	—


NOTE:  
THIS DRAWING IS PROVIDED FOR INSTRUCTIONAL DESIGN PURPOSES ONLY BASED ON METROLINX GO TRANSIT DESIGN GUIDELINES AND REQUIREMENTS. THE CONSULTANT SHALL VERIFY FOR LOCAL CODE COMPLIANCE, EXISTING SITE CONDITIONS AND INTER DISCIPLINARY DRAWING COORDINATION. ALL DIMENSIONS AND SPECIFICATIONS SHOULD BE VERIFIED BY CONSULTANT AND/OR CONTRACTOR BEFORE ACTUAL CONSTRUCTION BEGINS.

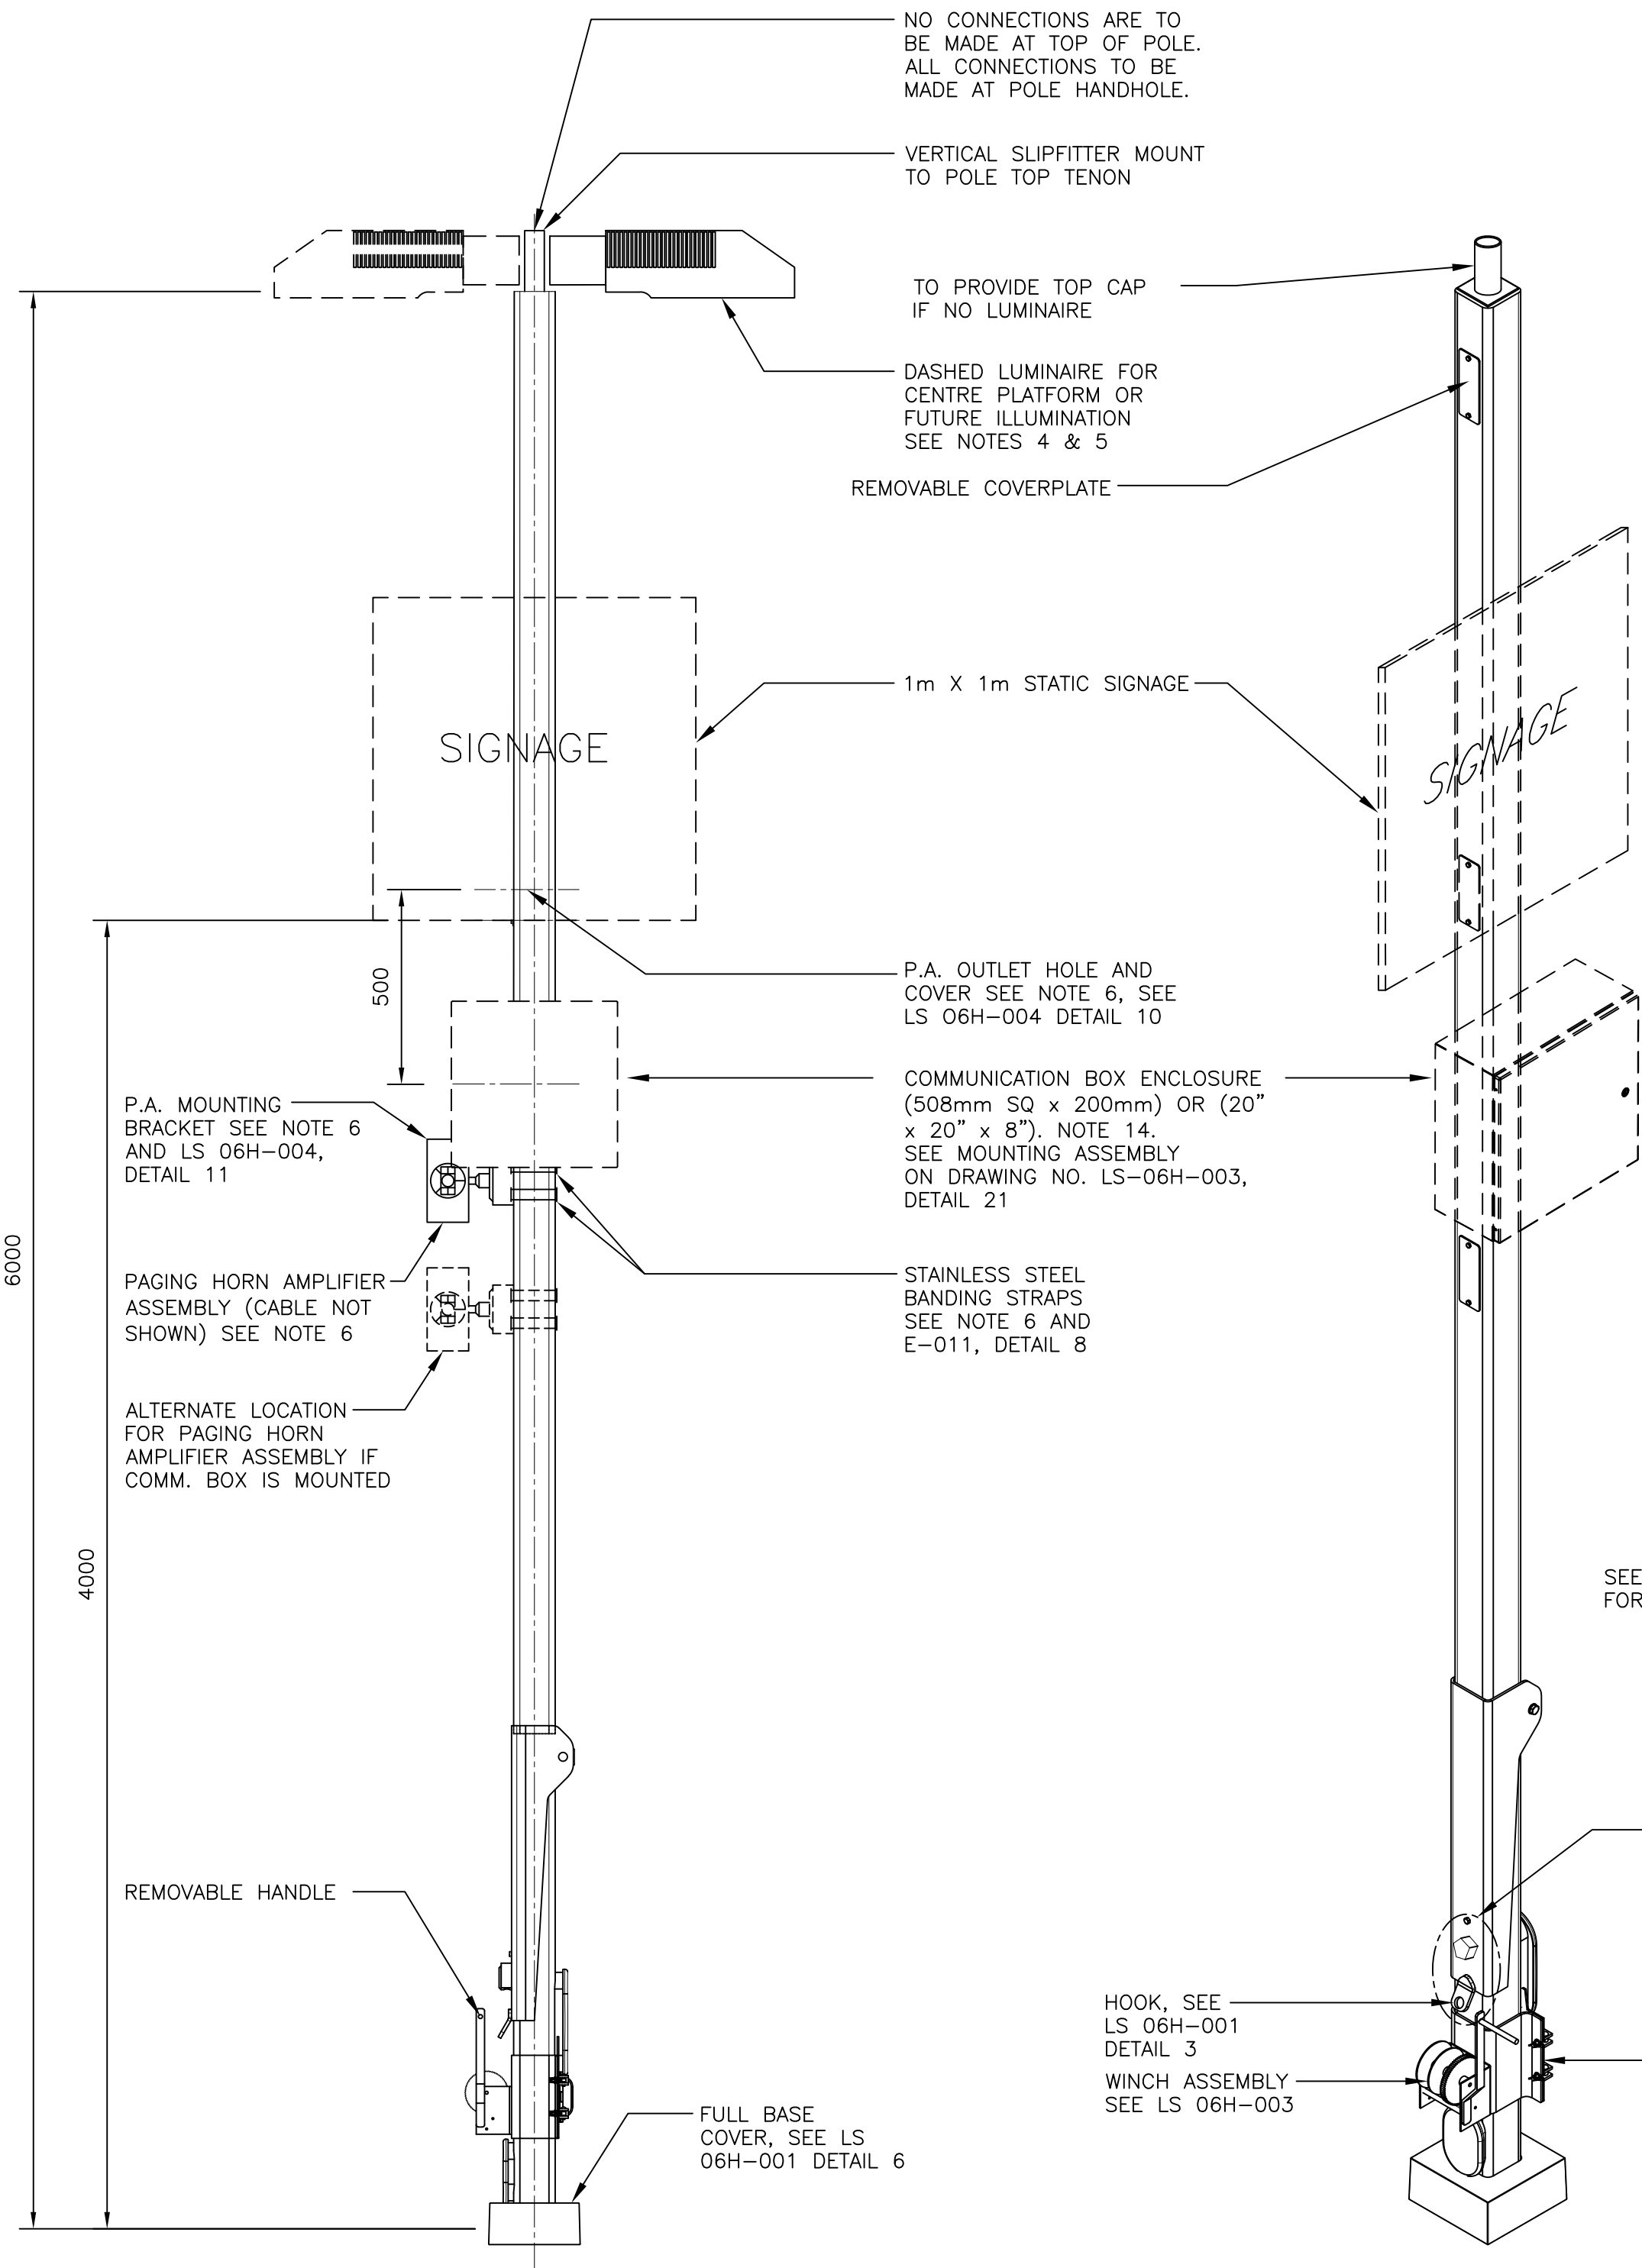

ELEVATION	A
TYPICAL PLATFORM LIGHTING POLE ASSEMBLY	—

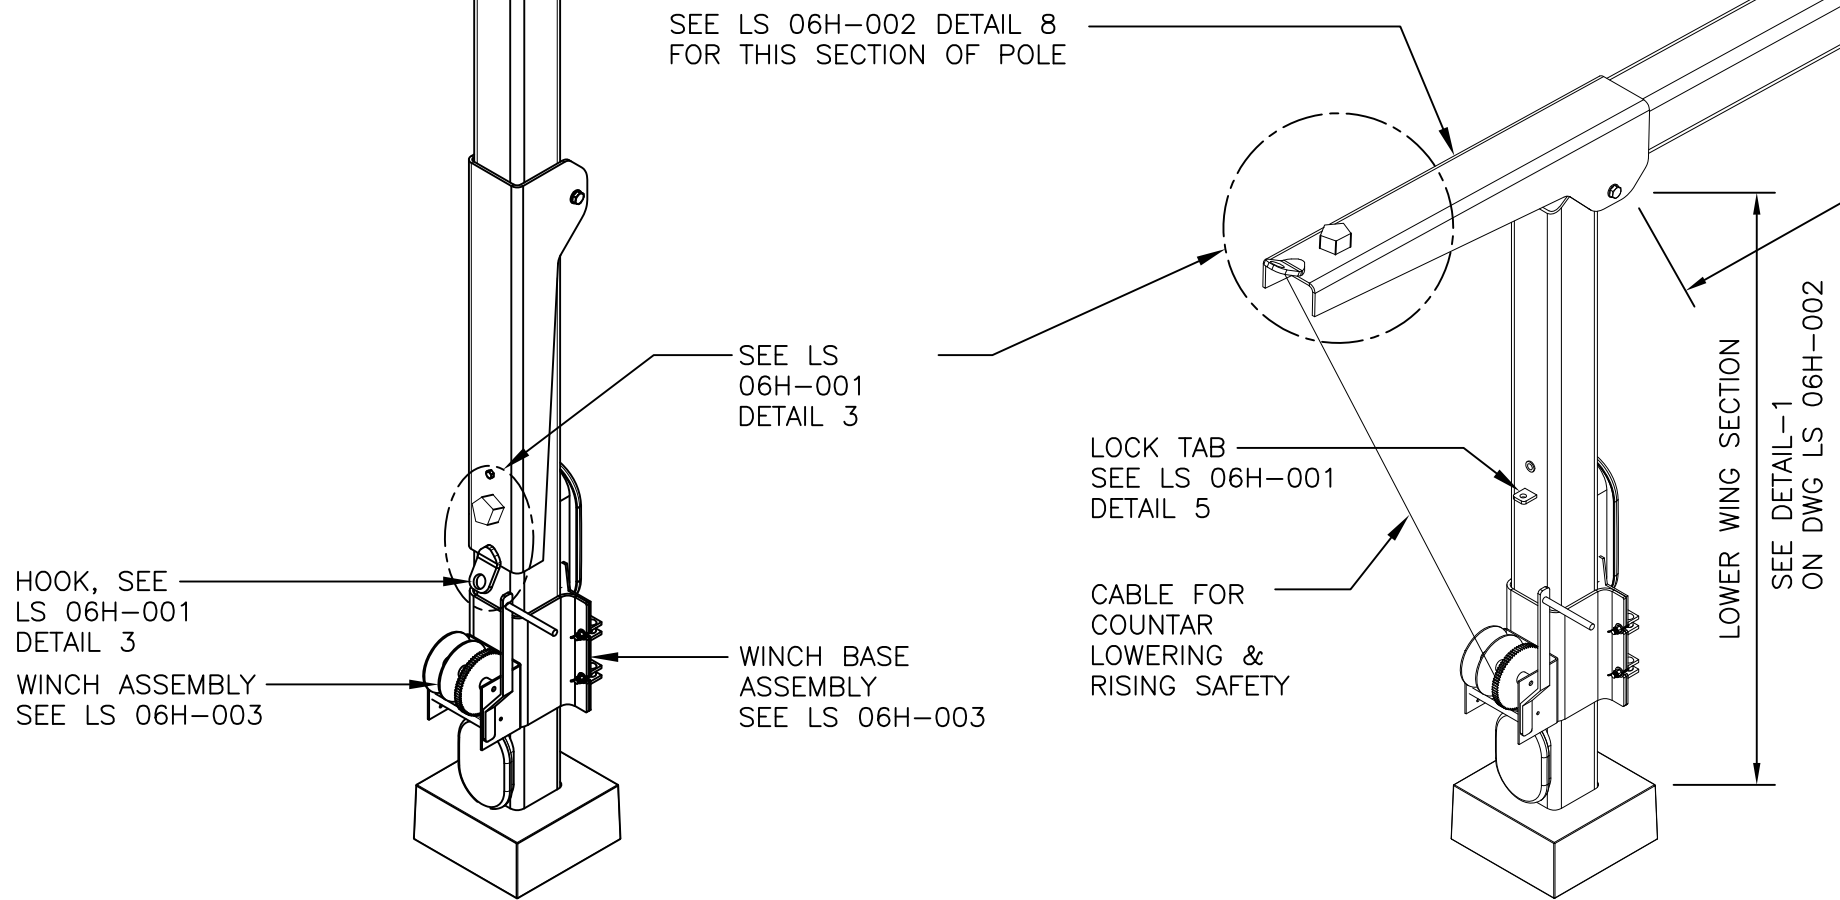


ISOMETRIC VIEW	
TYPICAL PLATFORM LIGHTING	
POLE ASSEMBLY	

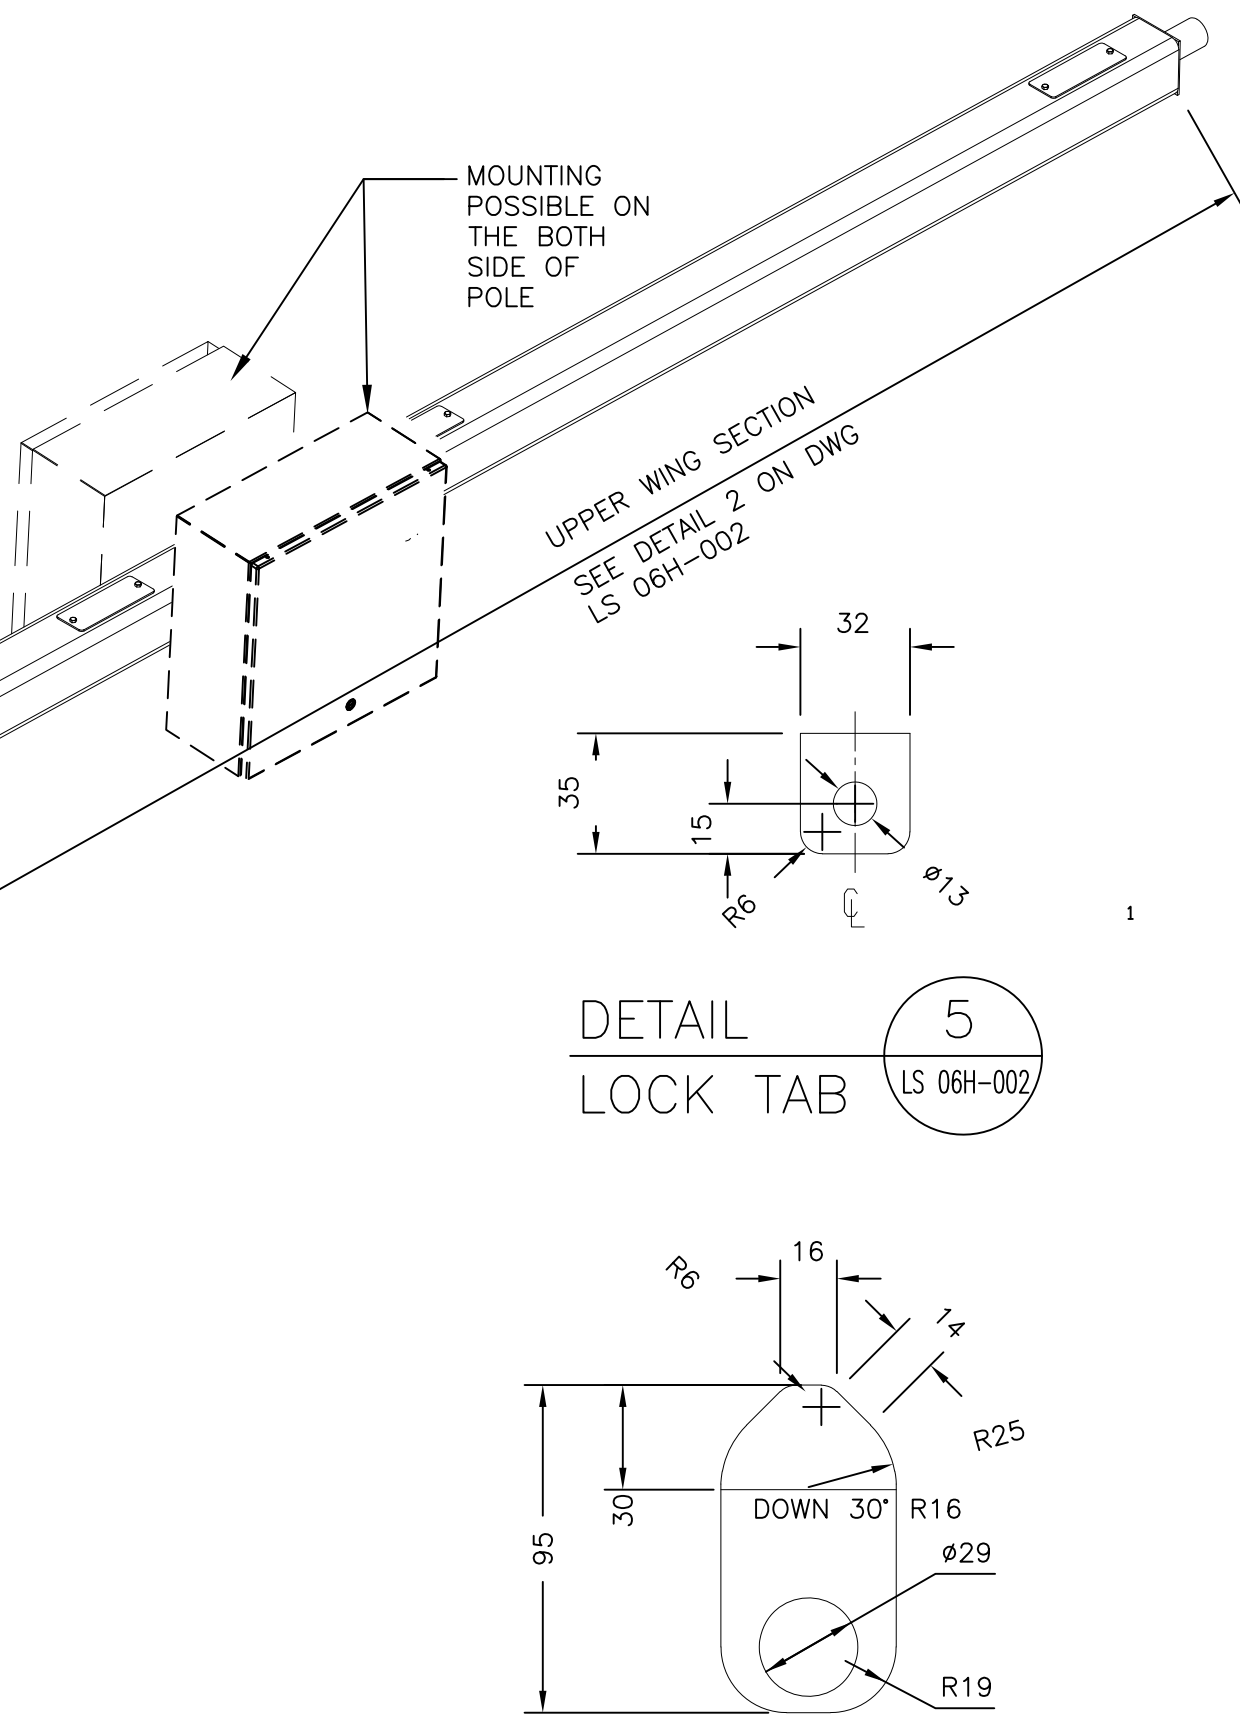


DETAIL  
LOCK TAB

5  
LS 06H-002

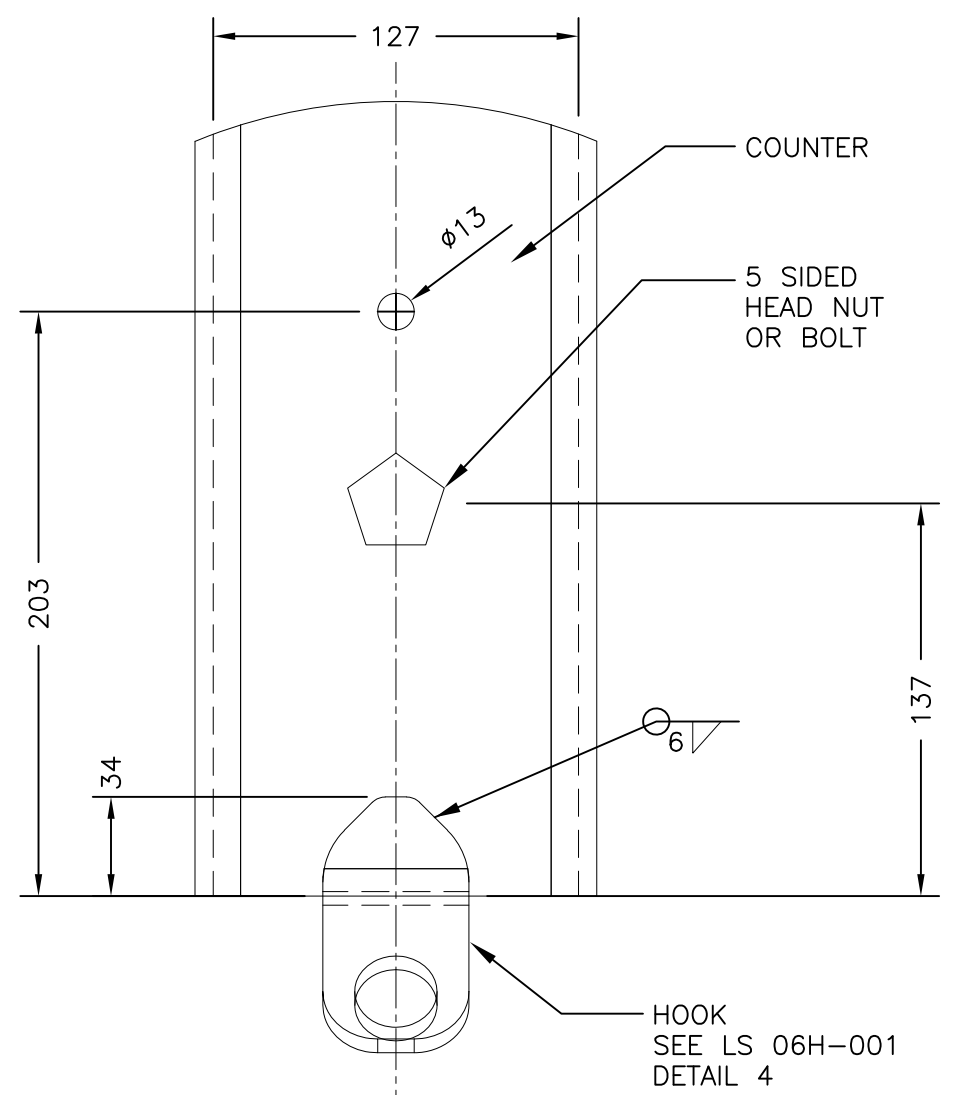

DETAIL 3  
LS 06H-002

METROLINX PROJECT NO. XXXXXX

REFERENCE DRAWINGS		ISSUE		REVISIONS		DRAWN BY: X.X.X. YY/MM/DD	DESIGNED BY: YY/MM/DD				XXXXXXXXX STATION 6M LIGHT/SIGNAGE STANDARD-HINGED POLE STANDARD DETAILS			
						CHECKED BY: YY/MM/DD <th>APPROVED BY: YY/MM/DD</th> <th colspan="4"></th>	APPROVED BY: YY/MM/DD							
		2	26/05/14	REVISED NOTE 5										
		1	20/12/13	DISCLAIMER NOTE										
		0	10/01/12	NAME UPDATE		1	05/12/19				SIGNAGE AND CCTV POLES MADE SEPARATE			
DWG NO.	TITLE	REV.	DATE	ISSUED FOR		REV.	DATE	SCALE: N.T.S. FULL SIZE ONLY						