

CLEAN BACKFILL

20MPA CONCRETE

53mm PVC/FIBREGLASS

CONDUIT (TYPICAL)

20MPA CONCRETE IS

TRAFFIC AREAS AND

ALL PARKING LOTS OTHERWISE USE CLEAN BACKFILL

E-5002

REQUIRED IN HIGH

FINISHED GRADE


4 DUCTS INSTALLATION DETAILS

100

(TYP.)

4x53mm

(TYP.)



- THE CONNECTION OF HANDWELLS/PULL BOXES TO DRAINAGE SYSTEM TO BE COORDINATED IN FIELD. PROVIDE 300mm OF CLEAR STONE BEDDING BELOW HANDWELLS/PULLBOXES.
- REFER TO OPSD 2112.040 REGARDING ELECTRICAL HANDHOLE PRECAST CONCRETE.
- 4. REFER TO OPSD 2117.020 REGARDING ELECTRICAL HANDHOLES GENERAL INSTALLATION REQUIREMENTS.
- 5. REFER TO OPSD 2123.030 REGARDING ENTRY OF DIRECT BURIED AND
- 6. REFER TO OPSD 401.010 REGARDING MAINTENANCE HOLES.

## NOTES - UNDERGROUND TRENCH DETAILS

ALL DIMENSIONS SHOWN ARE IN METRES AND/OR MILLIMETRES UNLESS OTHERWISE NOTED.

**METRIC** 


REV. SHEET


Ω


2. REFER TO METROLINX DRM FOR CONDUIT INSTALLATION, SPACING, CONDUIT FILL AND MAXIMUM NUMBER OF CONDUCTORS IN CONDUIT.


1. POWER AND COMMUNICATION CONDUITS MUST BE IN SEPARATE DUCT BANKS.

- DIMENSION "X" TO MEET OESC (ONTARIO ELECTRICAL SAFETY CODE) REQUIREMENTS BASED ON SYSTEM VOLTAGE.
- 4. ALL ELECTRICAL SYSTEM GROUNDING FOR POWER AND COMMUNICATIONS SHALL BE INSTALLED INSIDE OF THE CONDUIT WITHIN THE OCLZ.
- 5. CONDUITS CAN BE INSTALLED INSIDE SCHEDULE 40 OR GREATER STEEL PIPING (SLEEVES) TO CROSS TRACKS OR HIGH TRAFFIC AREA, PROVIDED THAT THE MINIMUM CONDUIT SPACING IS PER THE OESC, BASED ON THE SYSTEM'S VOLTAGE BEING MAINTAINED, AND THE METALLIC SLEEVE WITHIN THE OCLZ AREA IS BONDED TO THE TRACTION POWER RETURN.
- 6. HANDWELLS AND MANHOLES MUST CONTAIN DRAINAGE TO PREVENT THE ACCUMULATION OF WATER. SLOPE DUCTS AWAY FROM BUILDING ENTRANCES.
- 7. FOR HANDWELLS LOCATED IN ELECTRIFICATION ZONE, GROUNDING WIRE NEEDS TO BE VERIFIED TO WITHSTAND STEP AND TOUCH VOLTAGE LEVELS. COORDINATE WITH ELECTRIFICATION KA FAULT LEVELS AND TIMING. REFER TO DRM REQUIREMENTS OR GROUNDING WHICHEVER IS MORE
- 8. RACEWAYS AND BRANCH CIRCUITRY SHALL BE IMPLEMENTED TO MINIMIZE FAILURE OF A COMPLETE SYSTEM DUE TO FAILURE OR MALFUNCTIONING OF ANY SINGLE ELECTRICAL
- 9. MINIMIZE THE DISTRIBUTION OF CONDUCTORS OF DIFFERENT CIRCUITS SHARING COMMON RACEWAYS, PULL BOXES, ETC.
- 10. RACEWAYS SELECTED SHALL RESIST MECHANICAL DAMAGE AND ENVIRONMENTAL DETERIORATION
- 11. SPECIAL ATTENTION SHALL BE APPLIED TO CORROSION INHIBITORS AND PROTECTIVE COATINGS OR TREATMENTS ON SURFACE MOUNTED CONDUIT IN AREAS CAPABLE OF CORROSION OR CONDENSATION DUE TO TEMPERATURE CHANGE AND PROTECTION AGAINST EMI/EMC SUCH AS
- 12. REFER TO COMMUNICATION DRAWINGS FOR COMPLETE LAYOUT.
- 13. PROVIDE STRUCTURAL SUPPORTS AND GROUNDING AS REQUIRED.
- 14. ACCOUNT FOR FUTURE LEVEL BOARDING WHEN ESTABLISHING THE DUCT BANK DEPTH.
- 15. THE TYPE OF CONTAINMENT ( DUCT BANK WITH/WITHOUT CONCRETE, DIRECT BURIED, ETC.) SHALL BE COORDINATED AS PER SITE CONDITIONS. DETAILS SHALL BE SUBMITTED FOR APPROVAL IN ACCORDANCE WITH OESC CODE AND PROJECT SPECIFICATIONS.
- 16. FOR CONCRETE DUCT BANKS, REINFORCEMENT DETAILS SHALL BE SUBMITTED FOR APPROVAL IN ACCORDANCE WITH CONTRACT AND PROJECT SPECIFICATIONS.
- 17. DESIGNATE TOP LEVEL OF CONDUITS AS SPARE FOR FUTURE USE AND EASE OF ACCESSIBILITY.

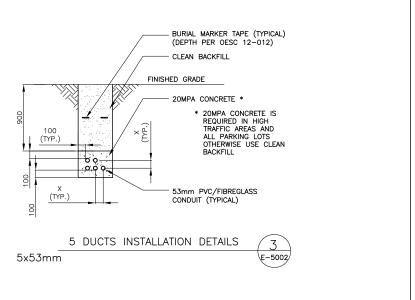

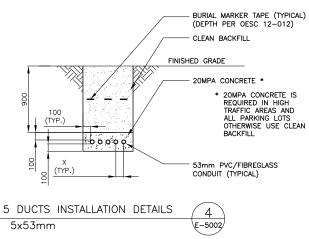

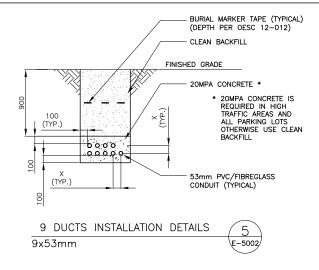

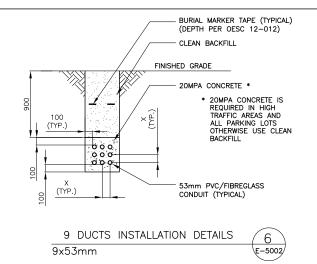

METROLINX PROJECT NO. DESIGNED BY: REFERENCE DRAWINGS ISSUE REVISIONS DRAWN BY: XXXXXXX STATION **△** METROLINX YY/MM/DD YY/MM/DD CHECKED BY: APPROVED BY: SAMPLE ELECTRICAL TRENCH DETAILS - 2 OF 2 YY/MM/DD YY/MM/DD SCALE: 1:XXX FULL SIZE ONLY 0 21/03/09 INITIAL ISSUE 165-SER-E-5002 TITLE NO. DATE ISSUED FOR DWG NO. REV. DATE