


NOTE:  
THIS DRAWING IS PROVIDED FOR INSTRUCTIONAL DESIGN PURPOSES ONLY BASED ON METROLINX GO TRANSIT DESIGN GUIDELINES AND REQUIREMENTS. THE CONSULTANT SHALL VERIFY FOR LOCAL CODE COMPLIANCE, EXISTING SITE CONDITIONS AND INTER DISCIPLINARY DRAWING COORDINATION. ALL DIMENSIONS AND SPECIFICATIONS SHOULD BE VERIFIED BY CONSULTANT AND/OR CONTRACTOR BEFORE ACTUAL CONSTRUCTION BEGINS.

ALL DIMENSIONS SHOWN ARE IN METRES AND/OR MILLIMETRES UNLESS OTHERWISE NOTED.


GENERAL NOTES:

1. CONSULTANTS ARE TO REVIEW ALL WIRE SIZING TO TAKE INTO ACCOUNT; DERATING AND 3% MAXIMUM VOLTAGE DROP FACTORS. WIRE SIZES ARE SUGGESTIONS ONLY!
2. COMPONENT CROSS REFERENCES SHOWN AS: XXXY WHERE "XX" REPRESENTS FINAL 2 DIGITS OF REFERENCE DRAWING # AND "YY" REPRESENTS QUADRANT LOCATION ON DWG. I.E. 02C1 = WSP-002 QUAD. C1
3. ADDITIONAL CONTACTS MAY BE REQUIRED AND BE ADDED BY ADDITIONAL RELAYS TO THE CONTROLS
4. REFER TO ELECTRIFICATION STANDARDS AND SPECIFICATIONS FOR GROUNDING AND BONDING, EMI/EMG WITHSTAND REQUIREMENTS, CABLING REQUIREMENTS.

WIRE DUCTS

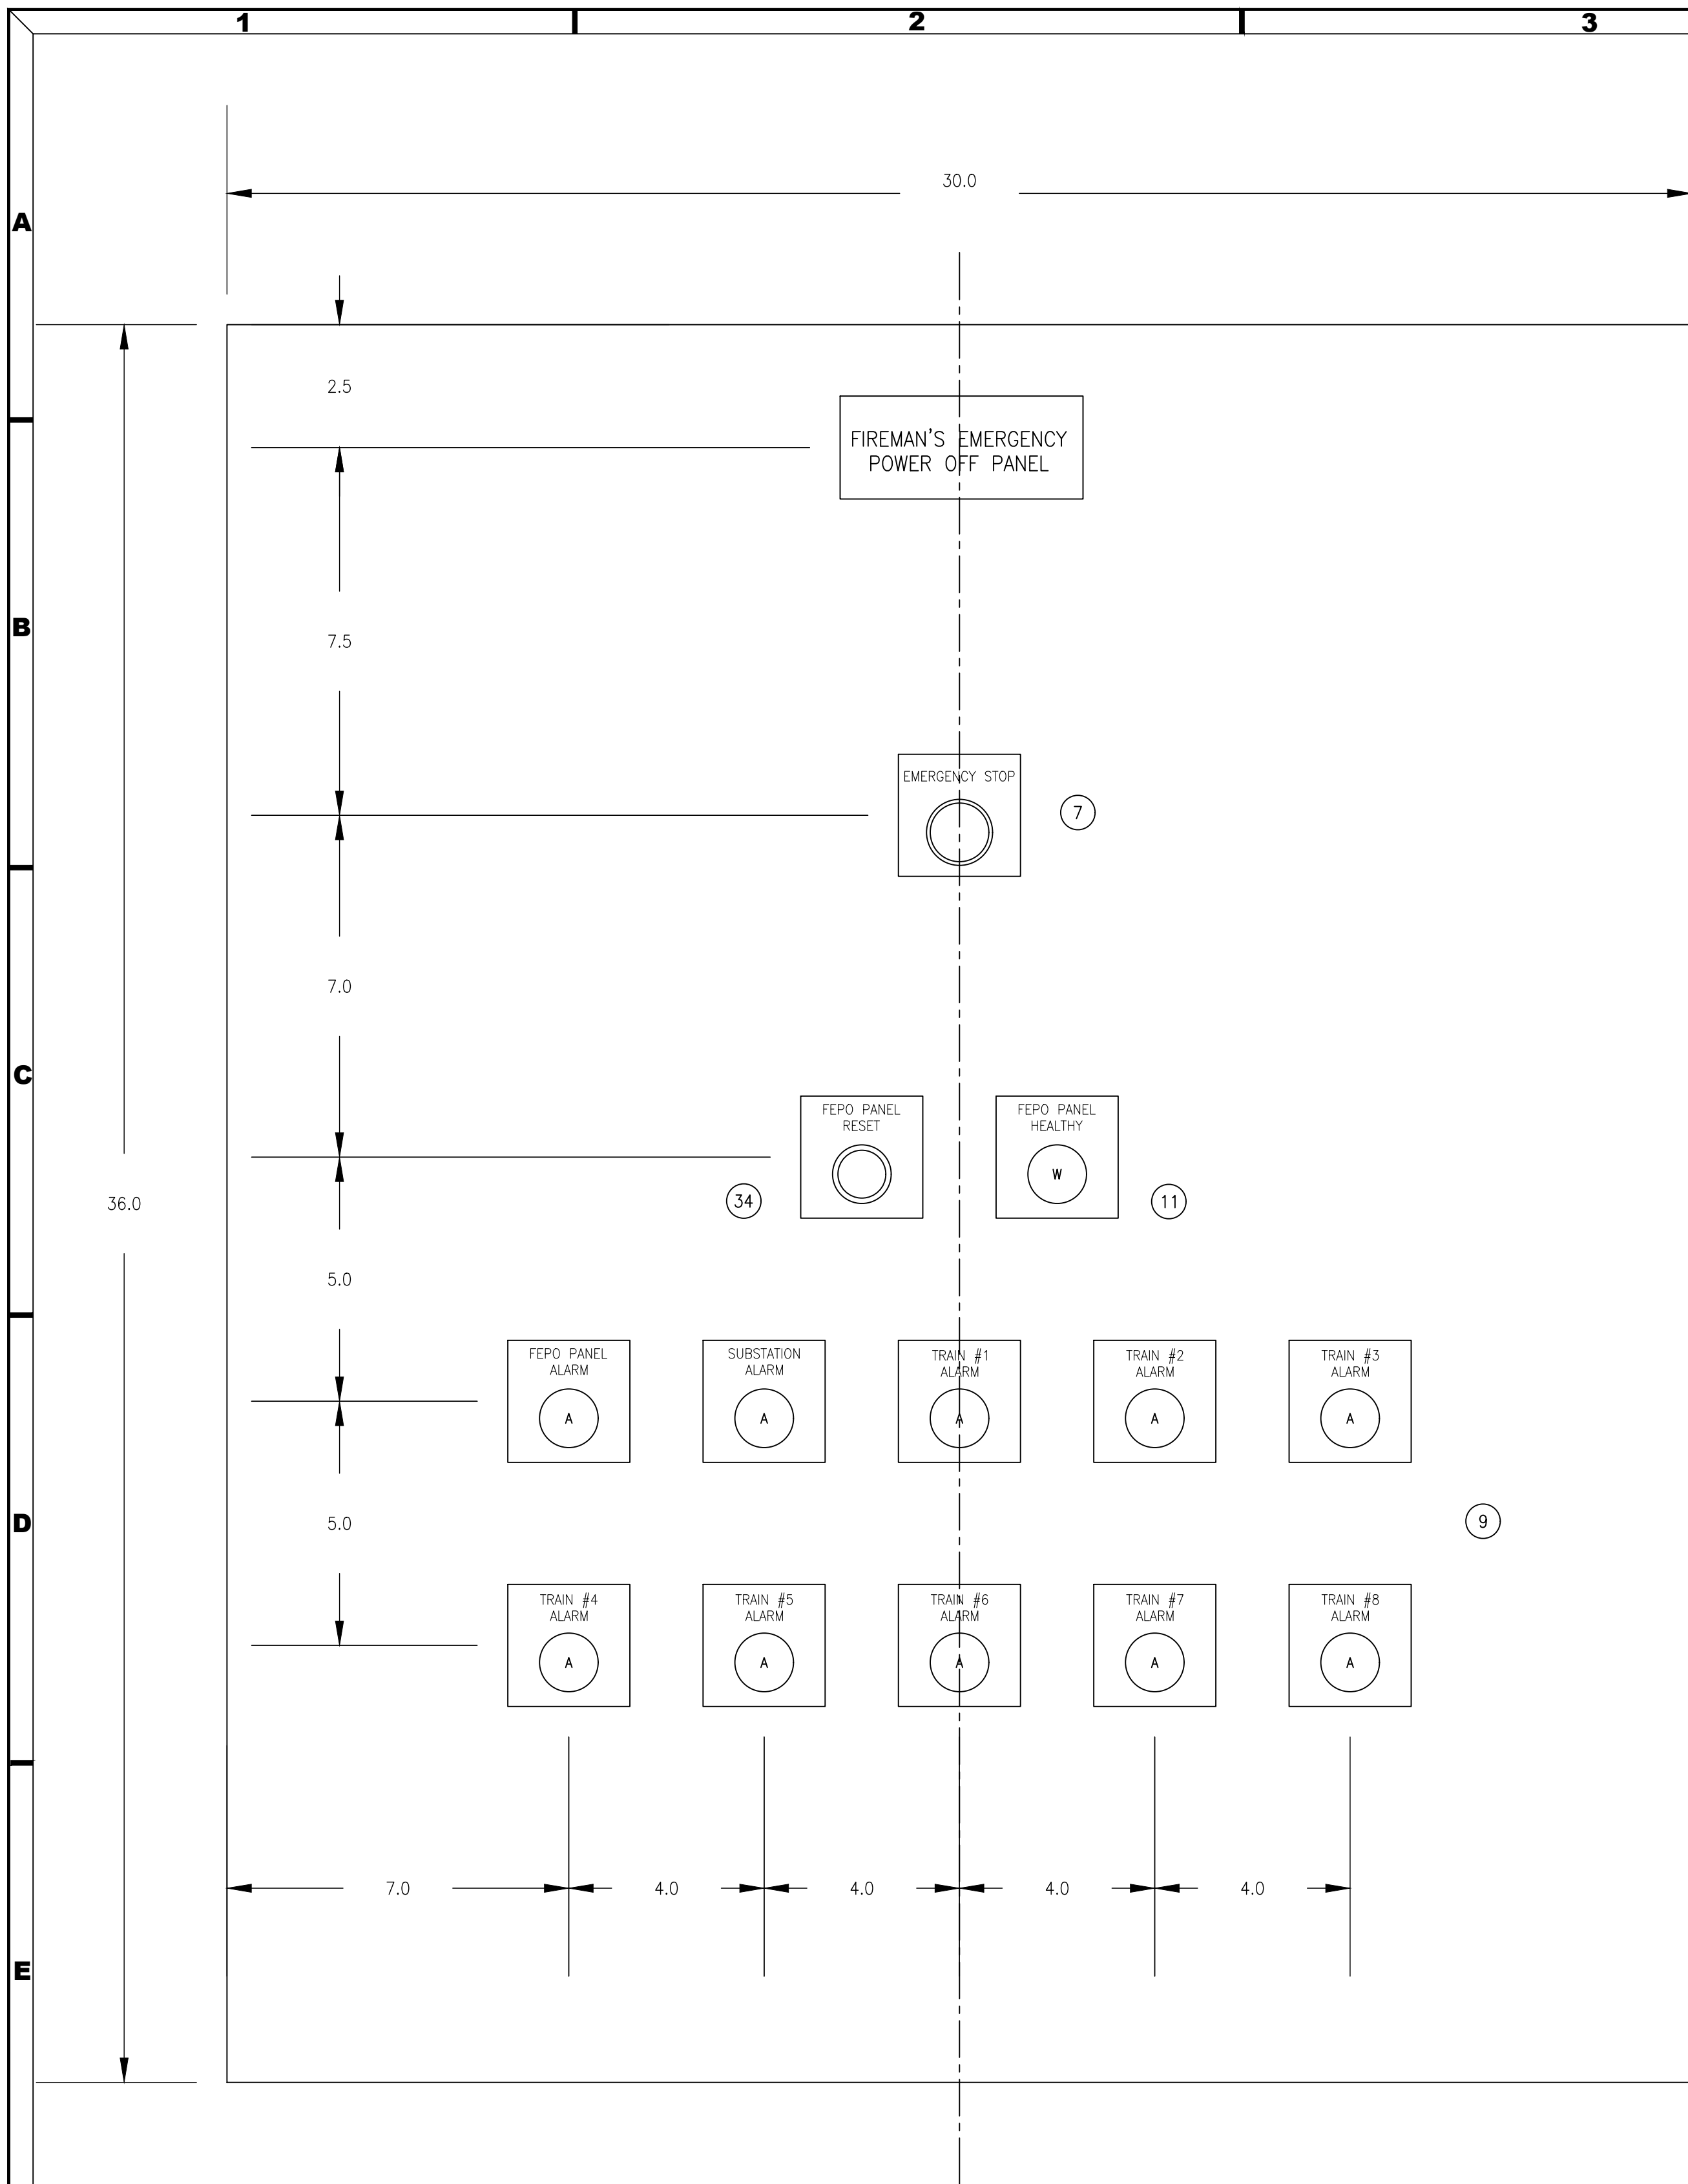

FRONT LAYOUT (ALL DIMENSIONS ARE IN INCHES.)

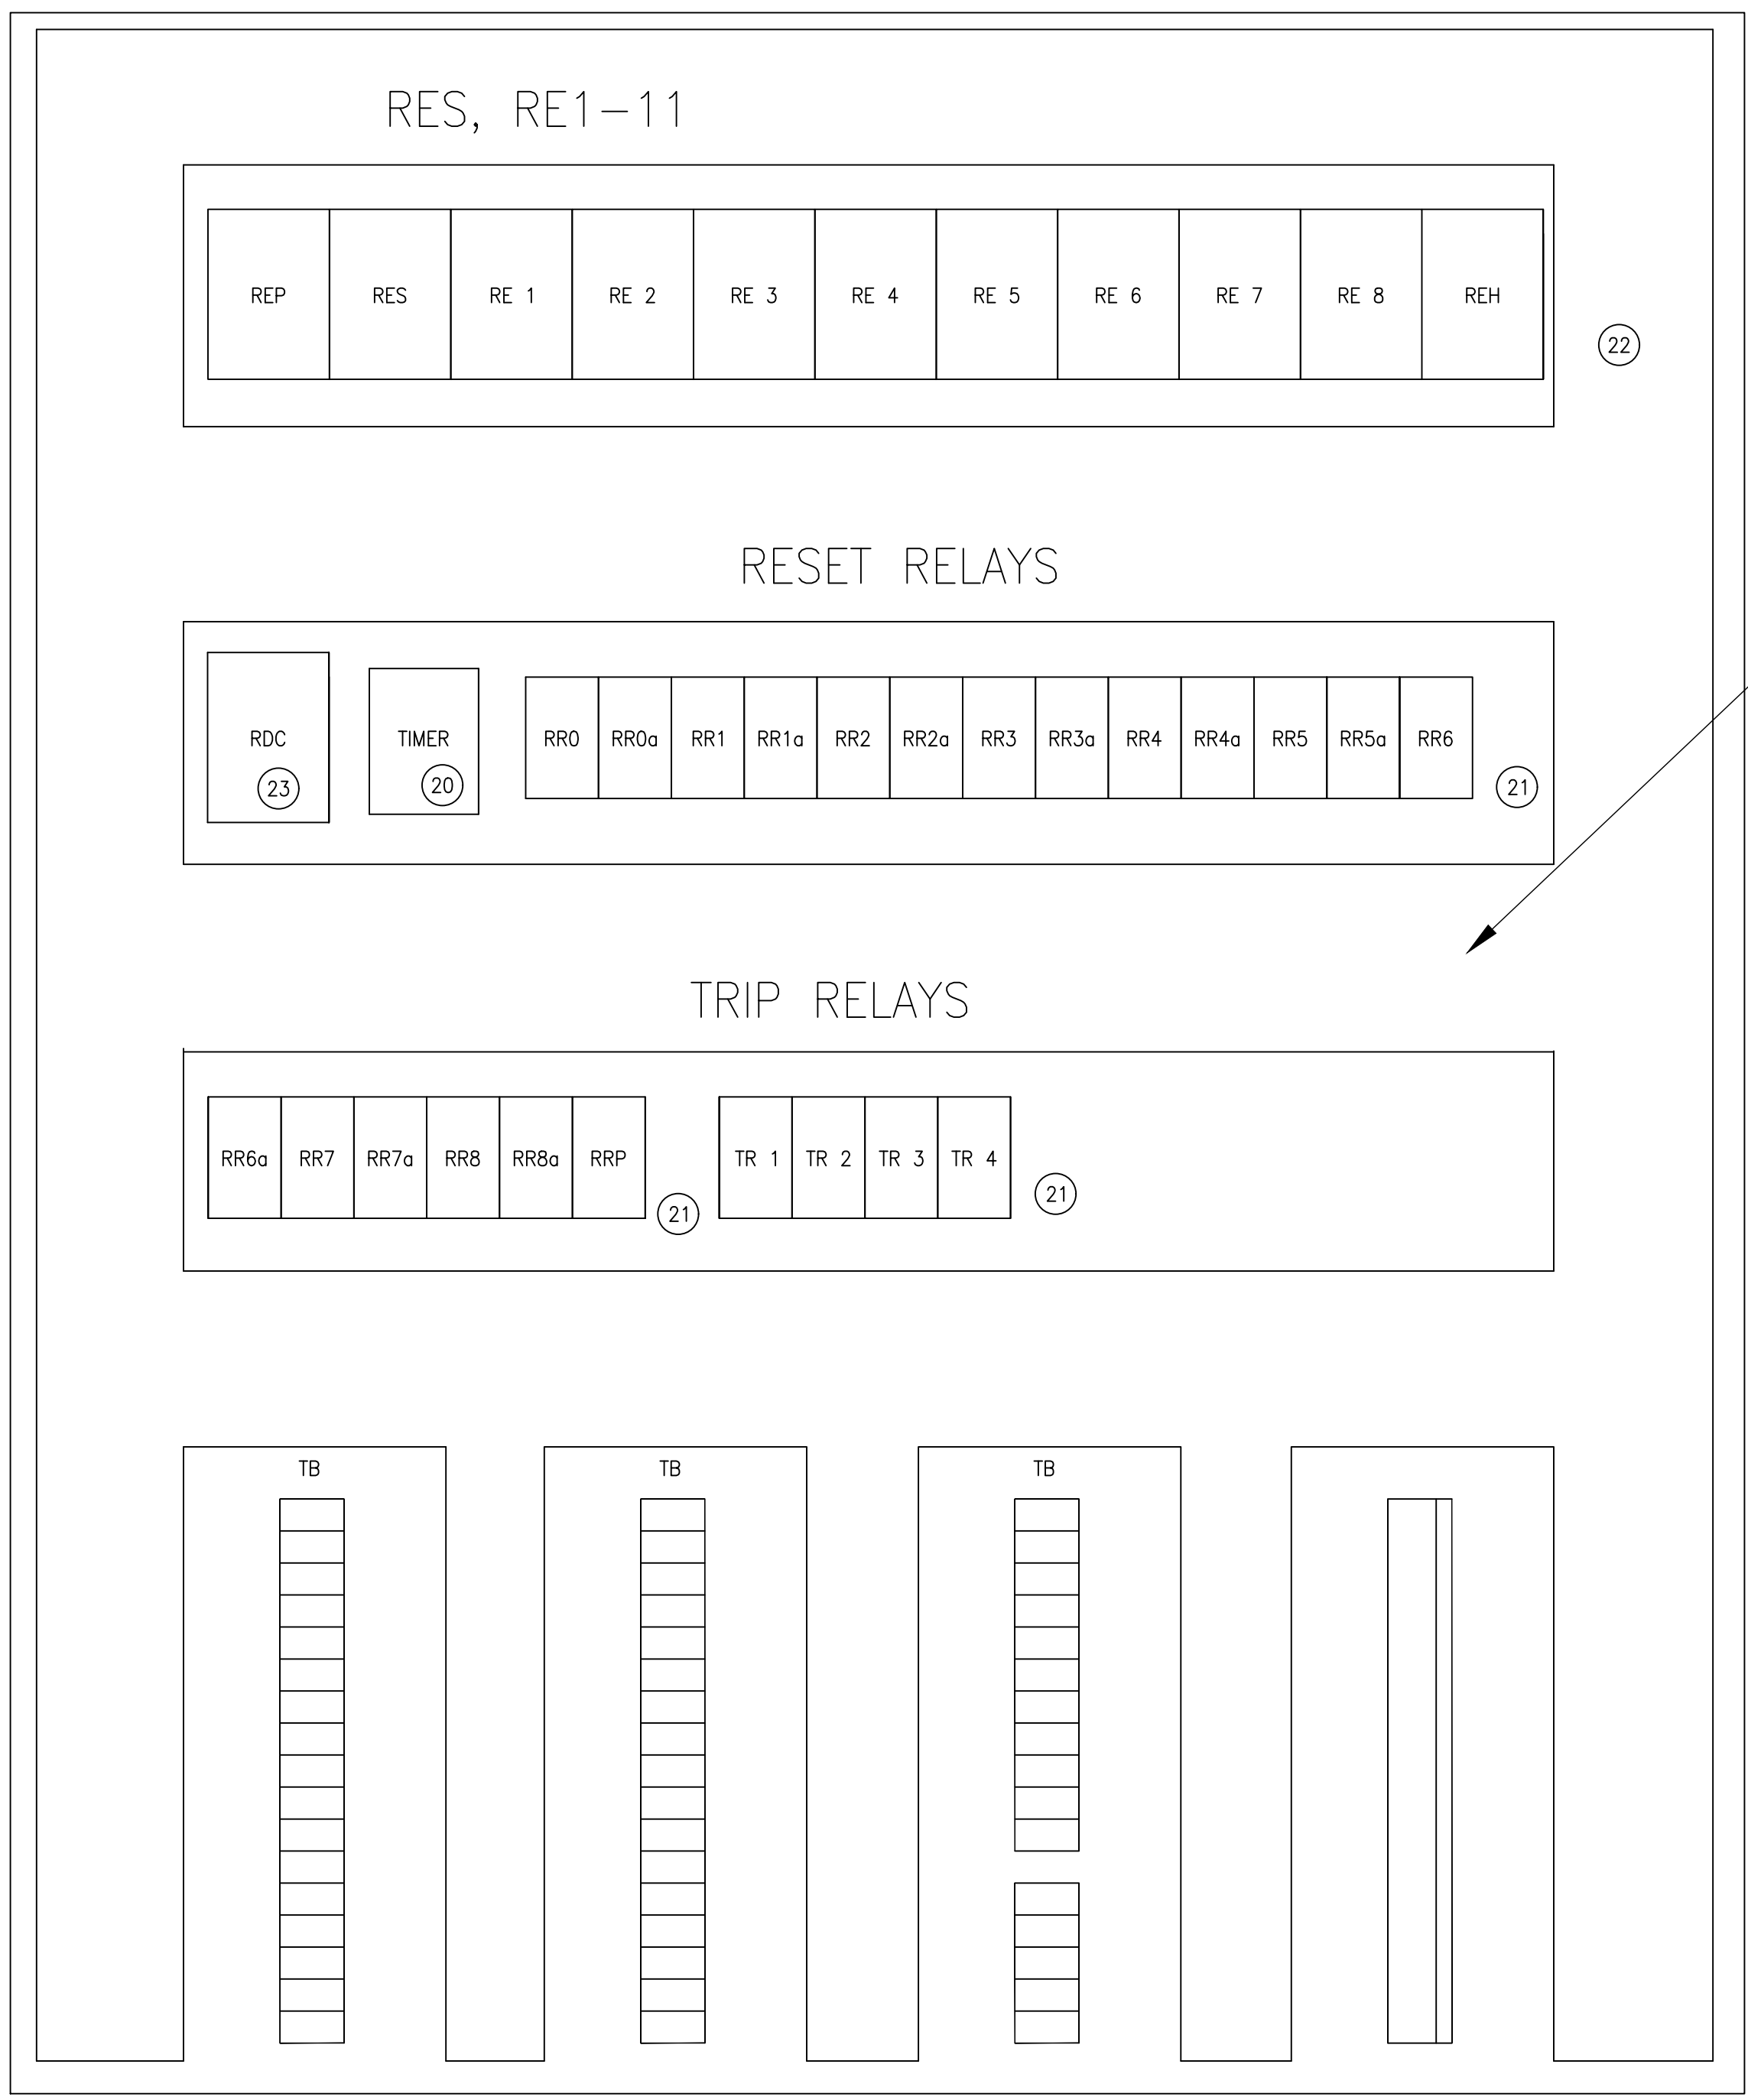


INSIDE LAYOUT

AutoCAD drawing: WSP-025.dwg Aug 15/18 12:28pm

GO TRANSIT PROJECT NO. XXXXX

REFERENCE DRAWINGS		ISSUE		REVISIONS		
DWG. NO.	TITLE	REV.	DATE	ISSUED FOR	REV.	DATE
					5	FEB. 2018
					4	DEC 2013
					3	MAR 2013
					2	JULY 2012
					1	SEPT.2010

DRAWN BY:	DESIGNED BY:
CHECKED BY:	APPROVED BY:
SCALE: N.T.S.	FULL SIZE ONLY

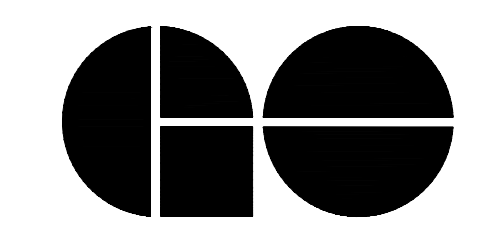

A Division of Metrolinx

XXXXXX WAYSIDE POWER FIREMAN EMERGENCY POWER OFF (FEPO) PANEL LAYOUT			
CONTRACT NO. XXXXXXXXXXXX	DWG. NO. WSP-025	REV. 5	SHEET XX