




FEPO PANEL

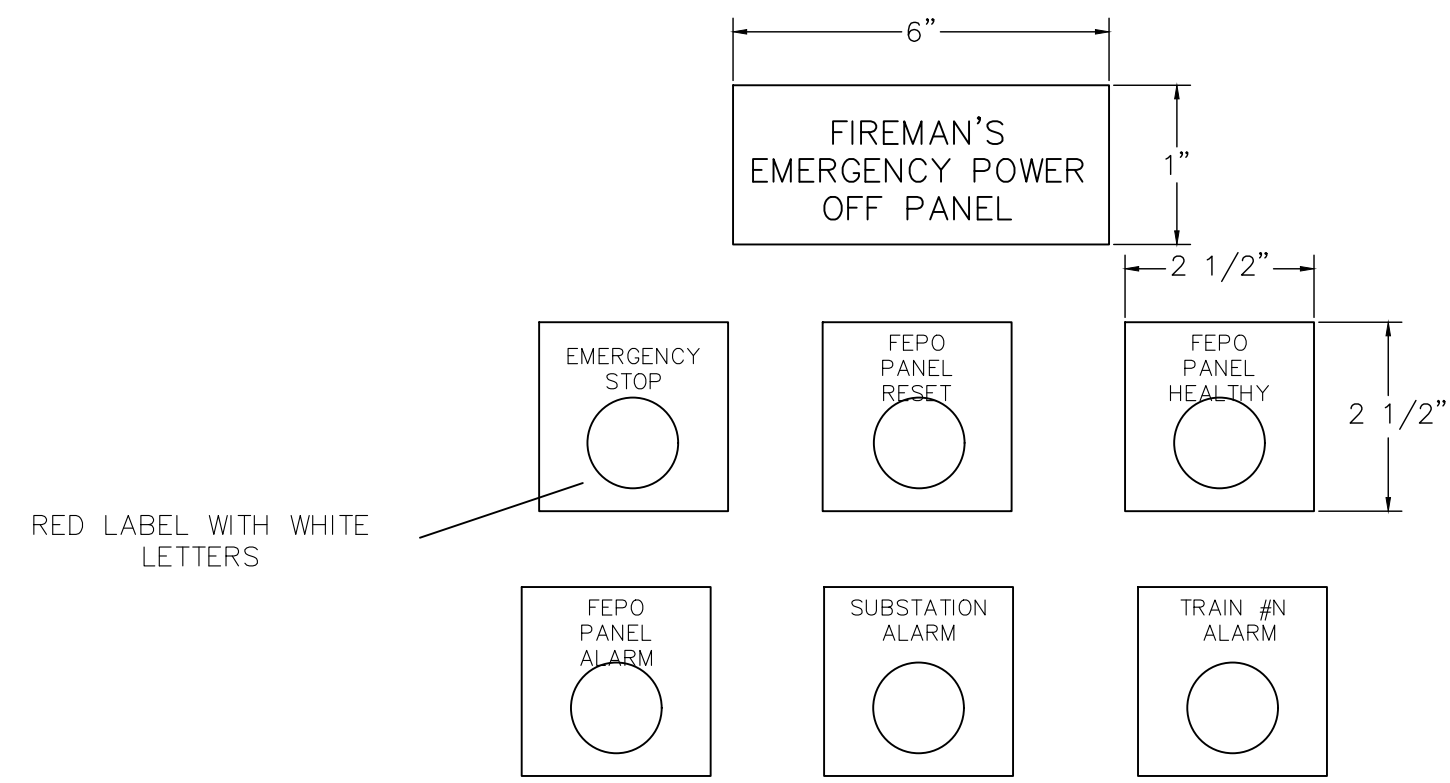

BREAKER INDICATOR PANEL

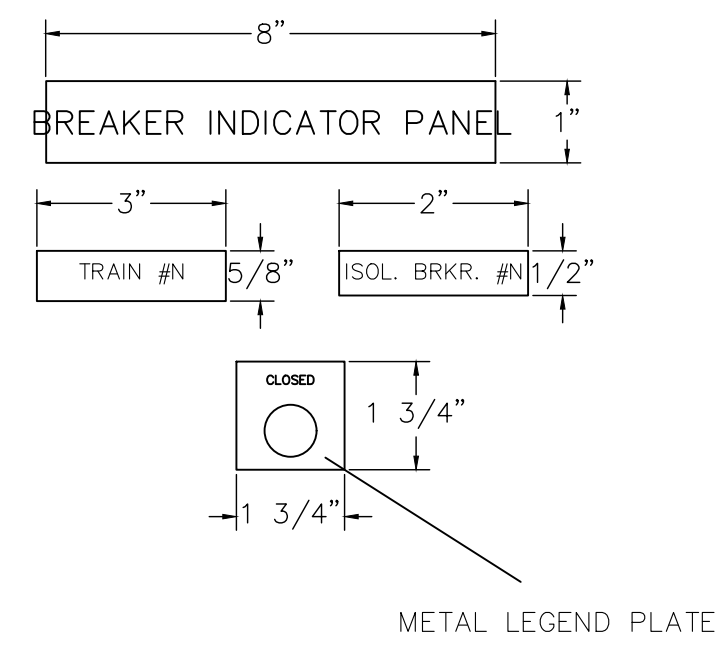

TELEM. PANEL

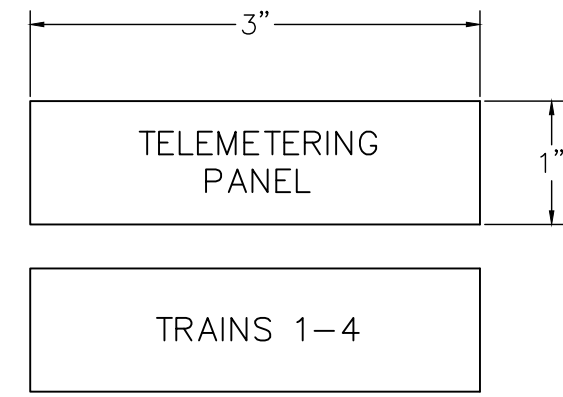

METRIC

ALL DIMENSIONS SHOWN ARE IN METRES AND/OR MILLIMETRES UNLESS OTHERWISE NOTED.


NOTES:

1. CONSULTANTS ARE TO REVIEW ALL WIRE SIZING TO TAKE INTO ACCOUNT; DERATING AND 3% MAXIMUM VOLTAGE DROP FACTORS. WIRE SIZES ARE SUGGESTIONS ONLY!
2. COMPONENT CROSS REFERENCES SHOWN AS: XXXY WHERE "XX" REP FINAL 2 DIGITS OF DWG # AND "Y" REP QUADRANT LOCATION ON DWG. IE: 02C1 = EDD-W1-002 QUAD, C1
3. ALL LABELS ARE BLACK LABELS WITH WHITE LETTERS UNLESS OTHERWISE NOTED.
4. REFER TO ELECTRIFICATION STANDARDS AND SPECIFICATIONS FOR GROUNDING AND BONDING, EMI/EMF WITHSTAND REQUIREMENTS, CABLING REQUIREMENTS.


NOTE:
THIS DRAWING IS TO BE USED ONLY AS A REFERENCE DRAWING FOR EXISTING INSTALLATIONS AND EXPANSION OF EXISTING EQUIPMENT AS NECESSARY. NOT TO BE USED IN NEW DESIGNS.

NOTE:
THIS DRAWING IS PROVIDED FOR INSTRUCTIONAL DESIGN PURPOSES ONLY BASED ON METROLINX GO TRANSIT DESIGN GUIDELINES AND REQUIREMENTS. THE CONSULTANT SHALL VERIFY FOR LOCAL CODE COMPLIANCE, EXISTING SITE CONDITIONS AND INTER DISCIPLINARY DRAWING COORDINATION. ALL DIMENSIONS AND SPECIFICATIONS SHOULD BE VERIFIED BY CONSULTANT AND/OR CONTRACTOR BEFORE ACTUAL CONSTRUCTION BEGINS.


WAYSIDE INTERIOR

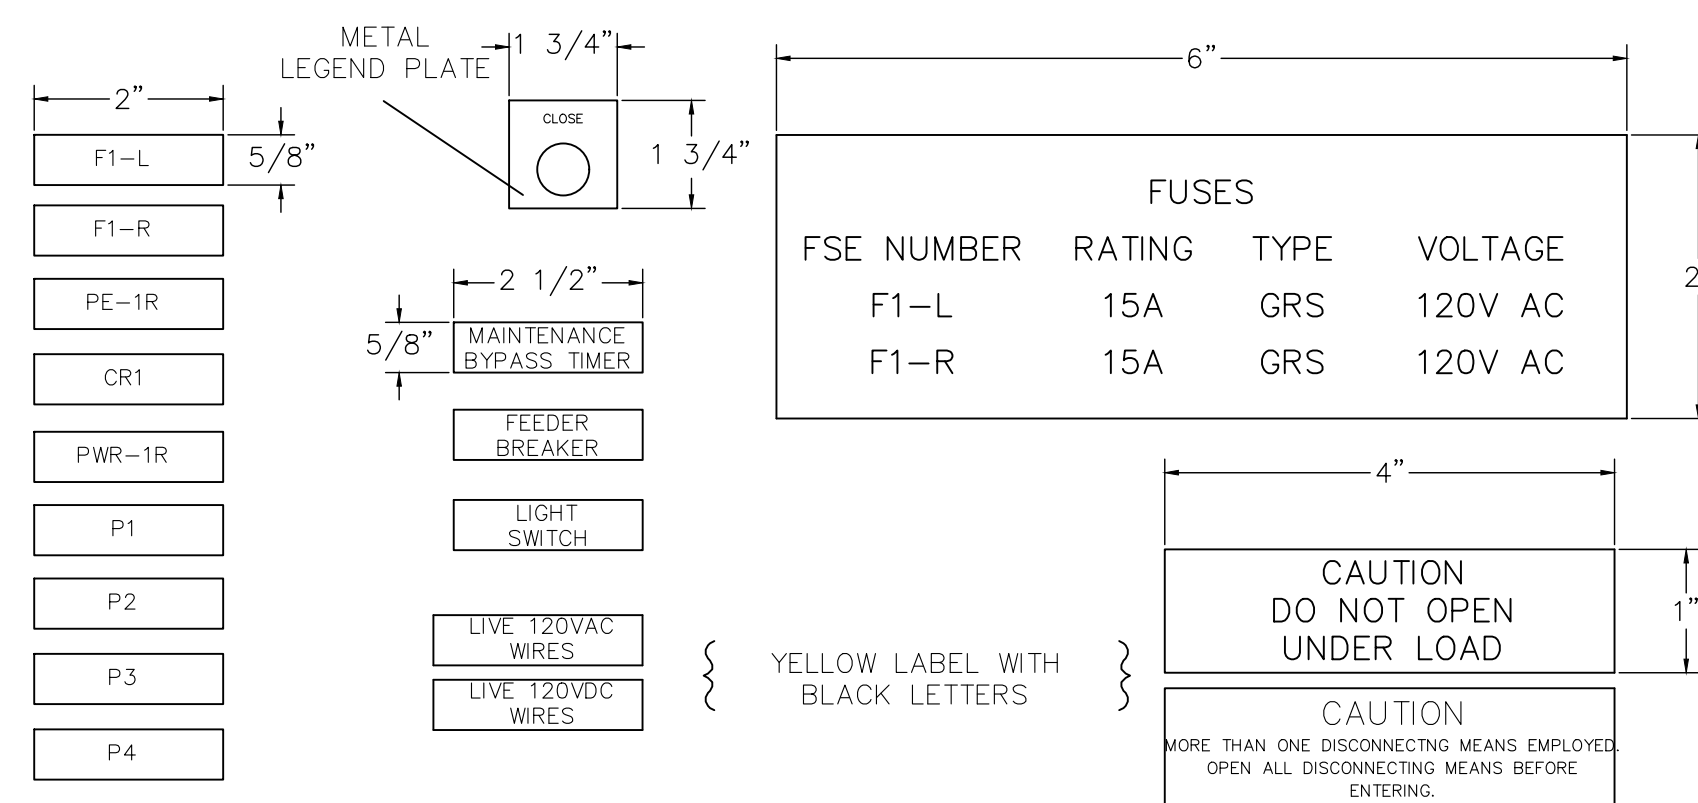


REMOTE OPERATIONAL PANEL

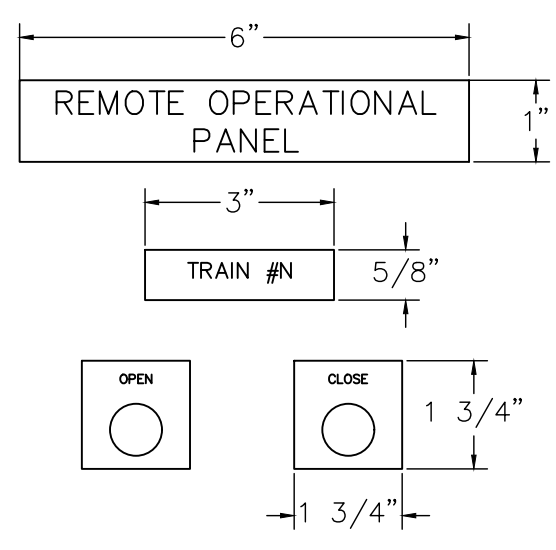

RELAY PANEL

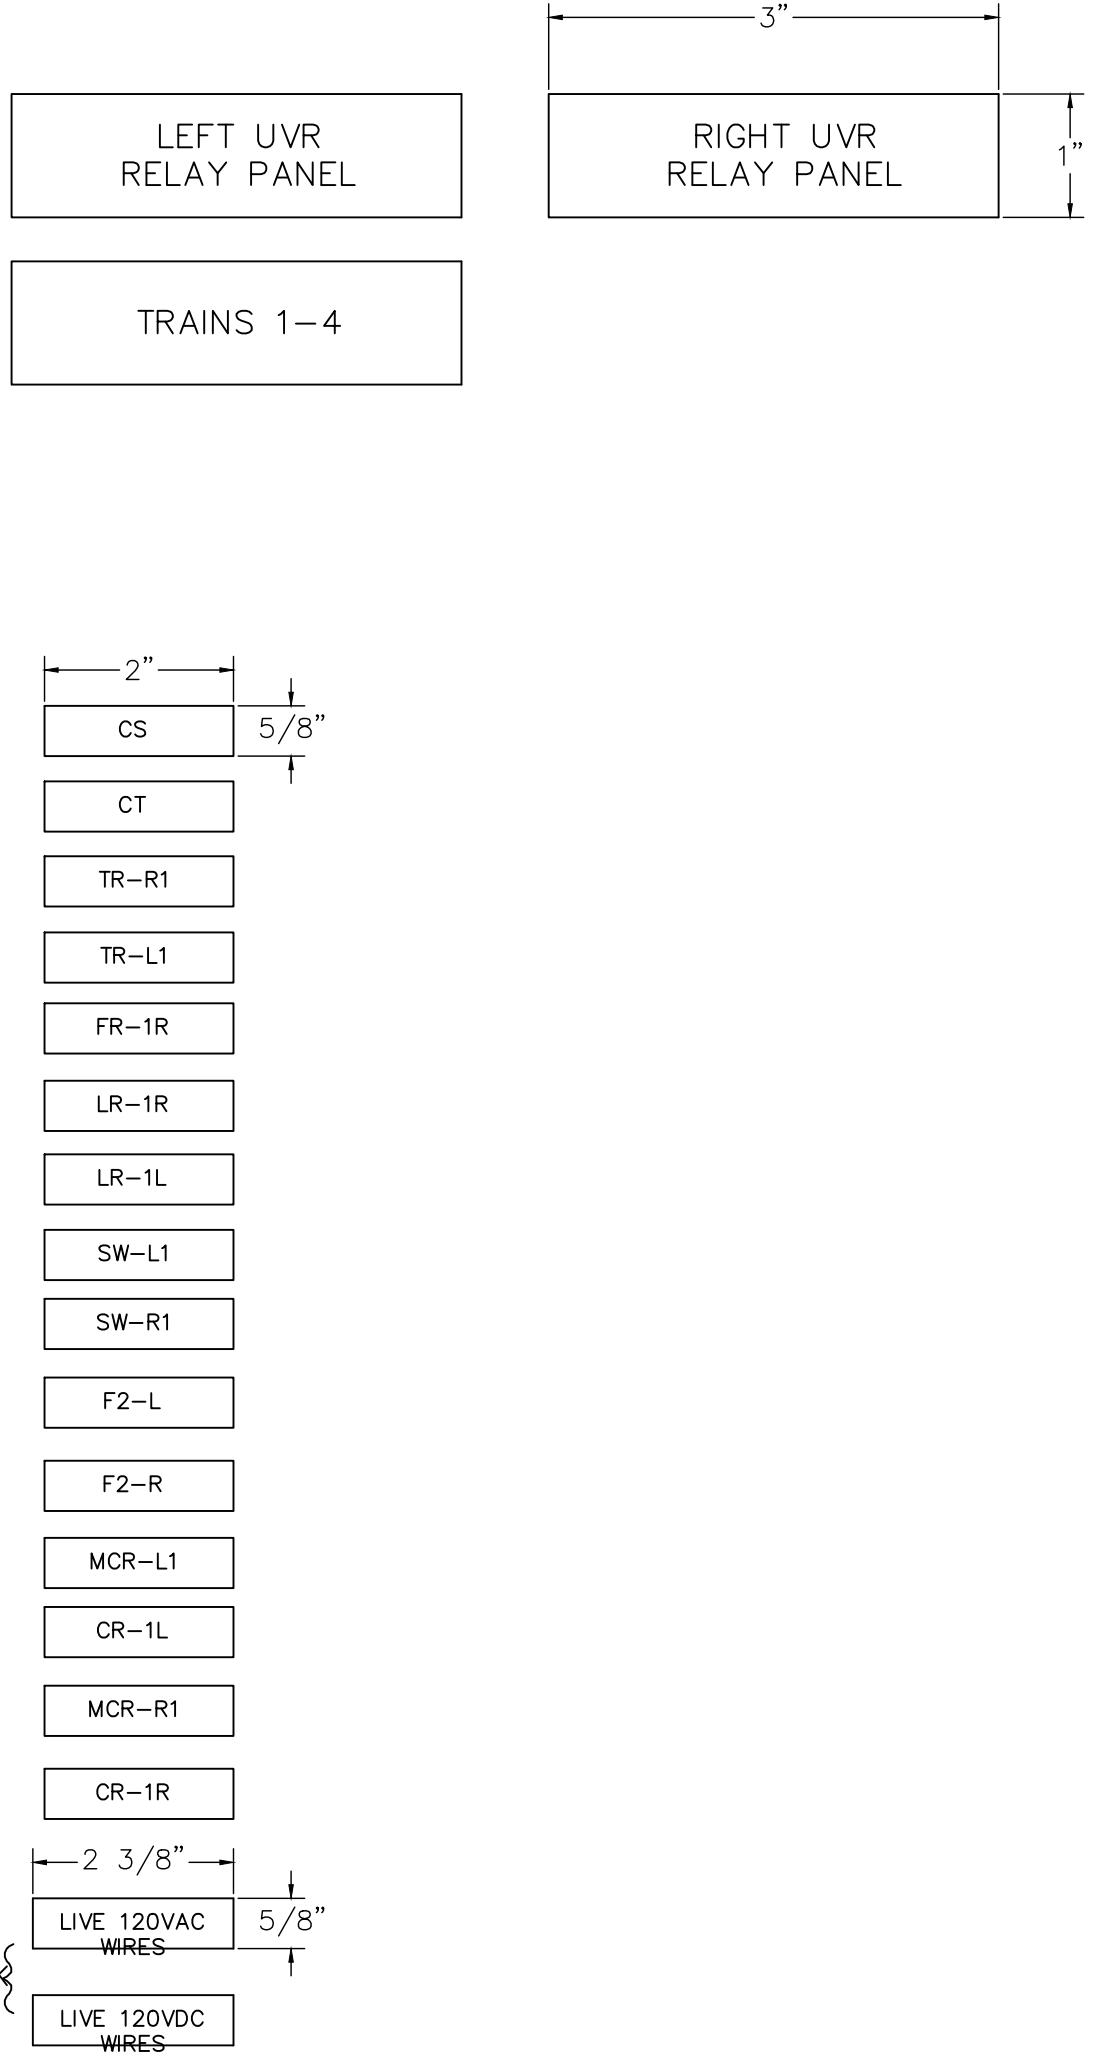

UVR DC SUPPLY PROTECTION PANEL

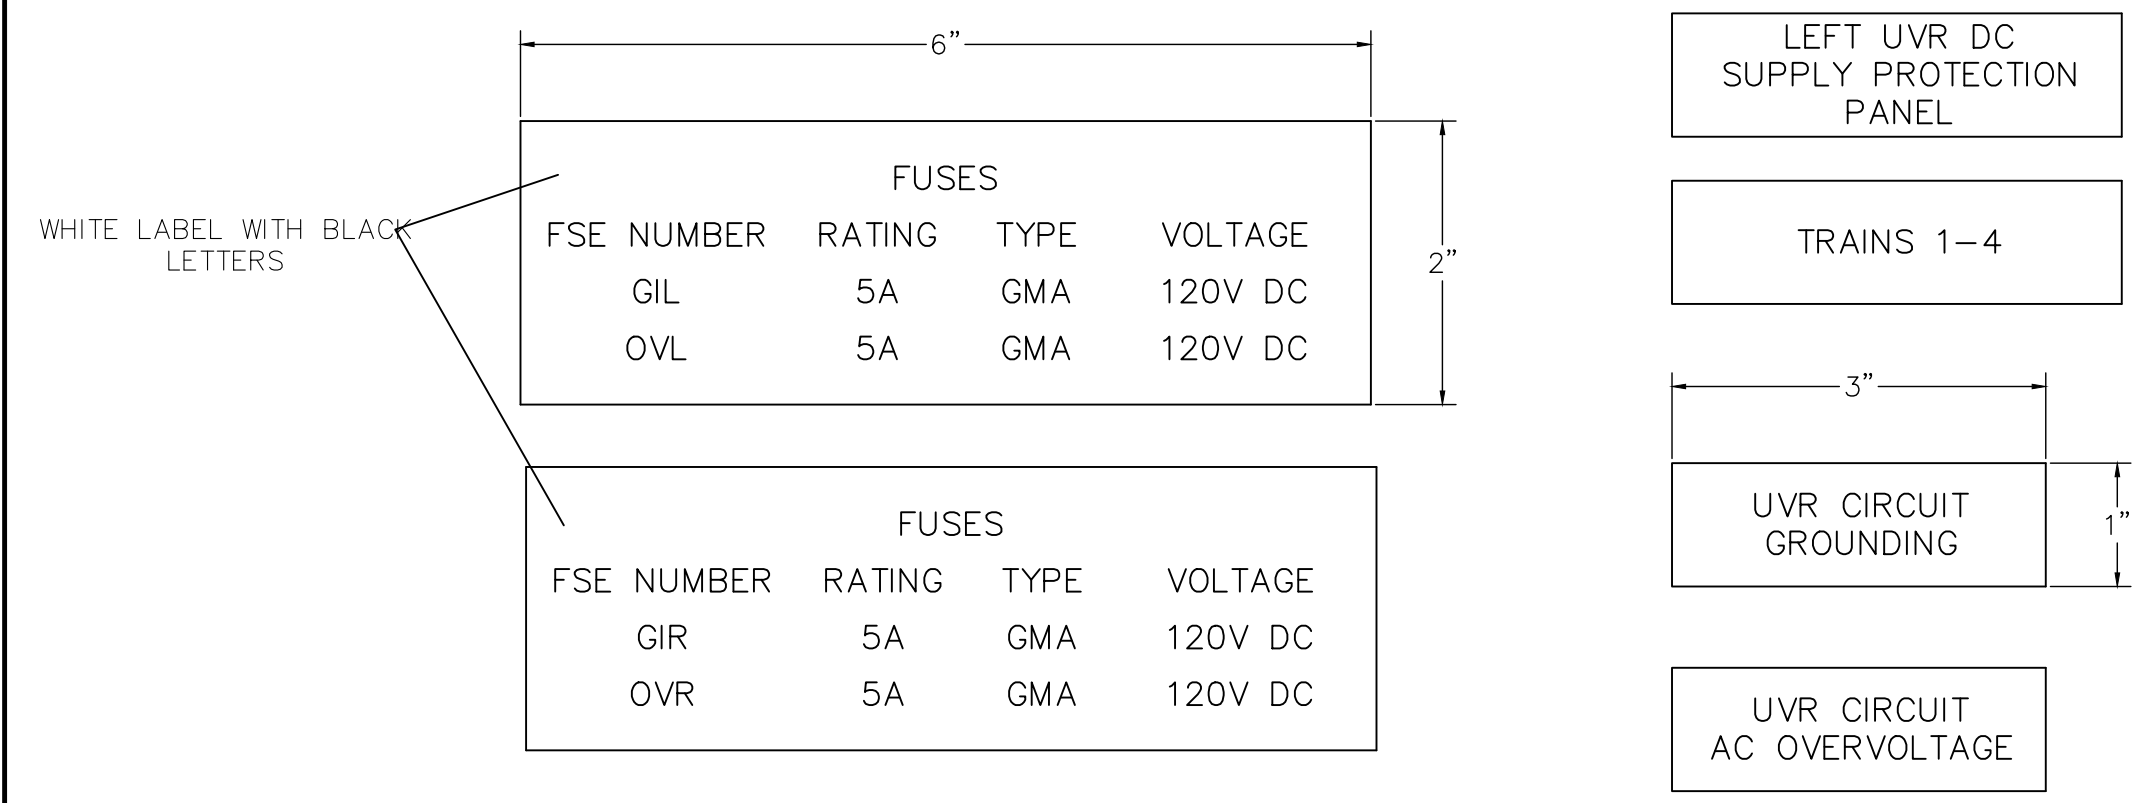

GO TRANSIT PROJECT NO. XX

REFERENCE DRAWINGS	ISSUE	REVISIONS	DRAWN BY:	DESIGNED BY:
			XX XX	XX XX
			CHECKED BY:	APPROVED BY:
			XX XX	XX XX
			SCALE: N.T.S.	FULL SIZE ONLY
DWG. NO.	TITLE	REV. DATE	ISSUED FOR	REV. DATE

DRAWN BY:	DESIGNED BY:
CHECKED BY:	APPROVED BY:
SCALE: N.T.S.	FULL SIZE ONLY



XXXXXX
WAYSIDE POWER
LABELS

CONTRACT NO. XX	DWG. NO. WSP-134	REV. 0	SHEET XX XX
--------------------	---------------------	-----------	----------------