

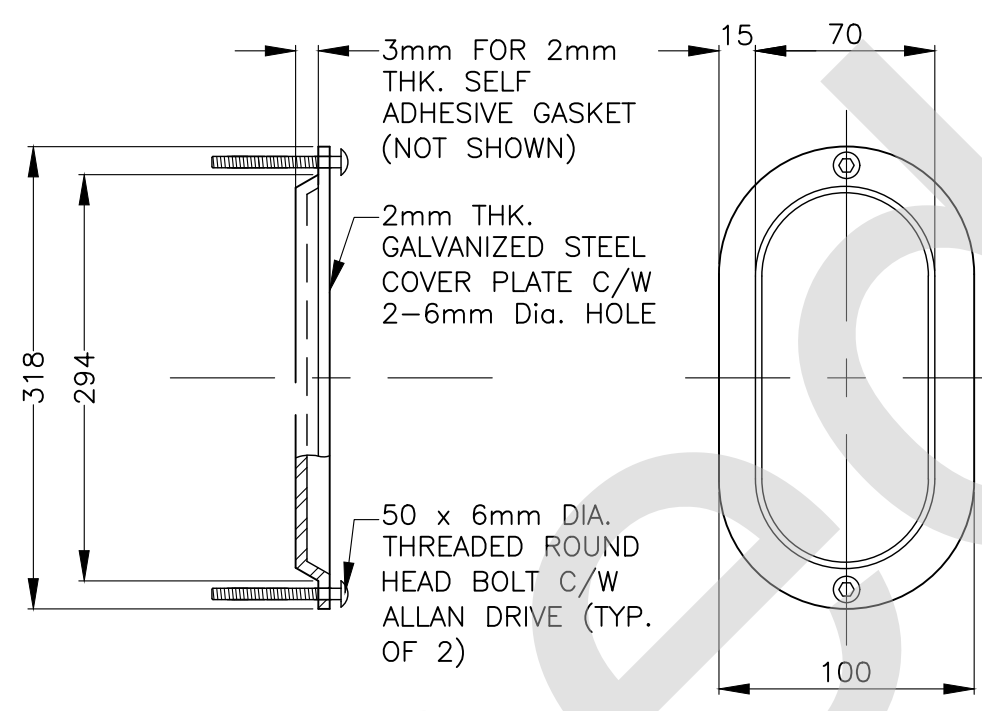
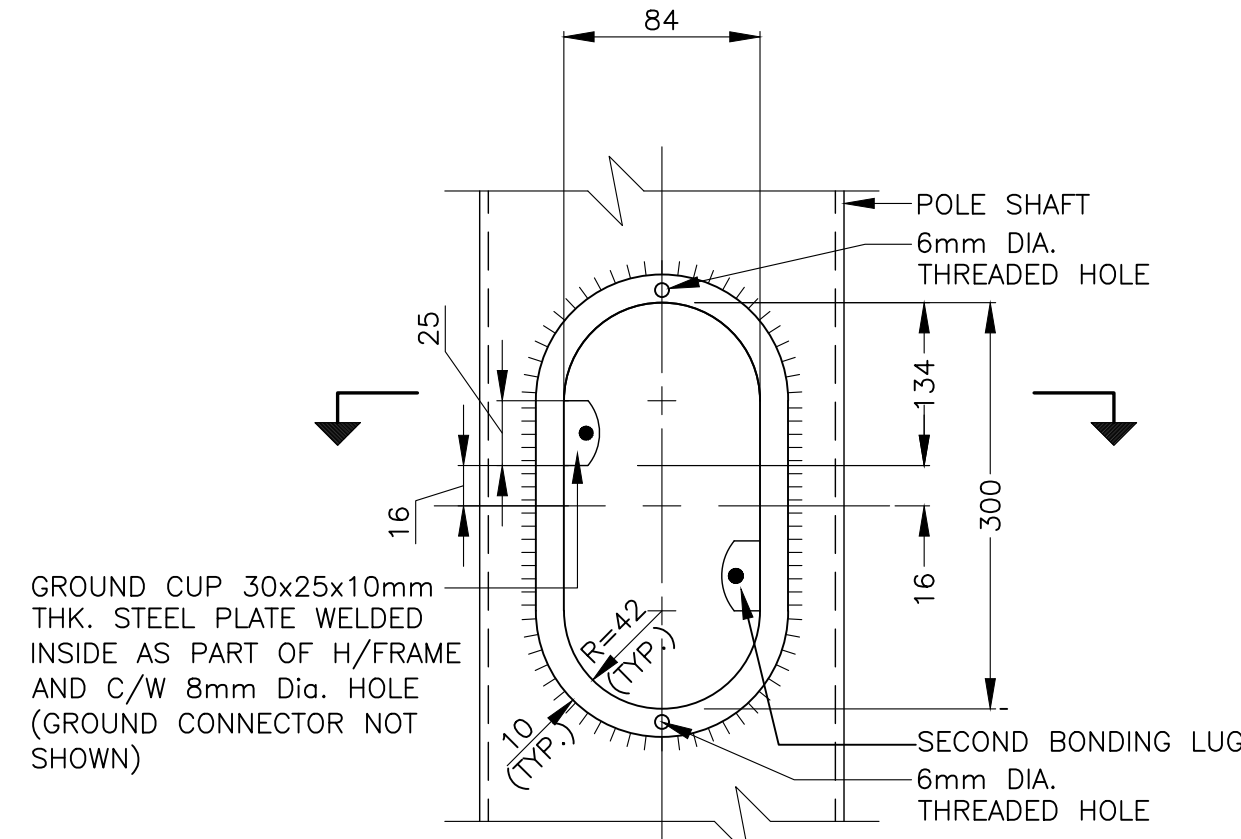
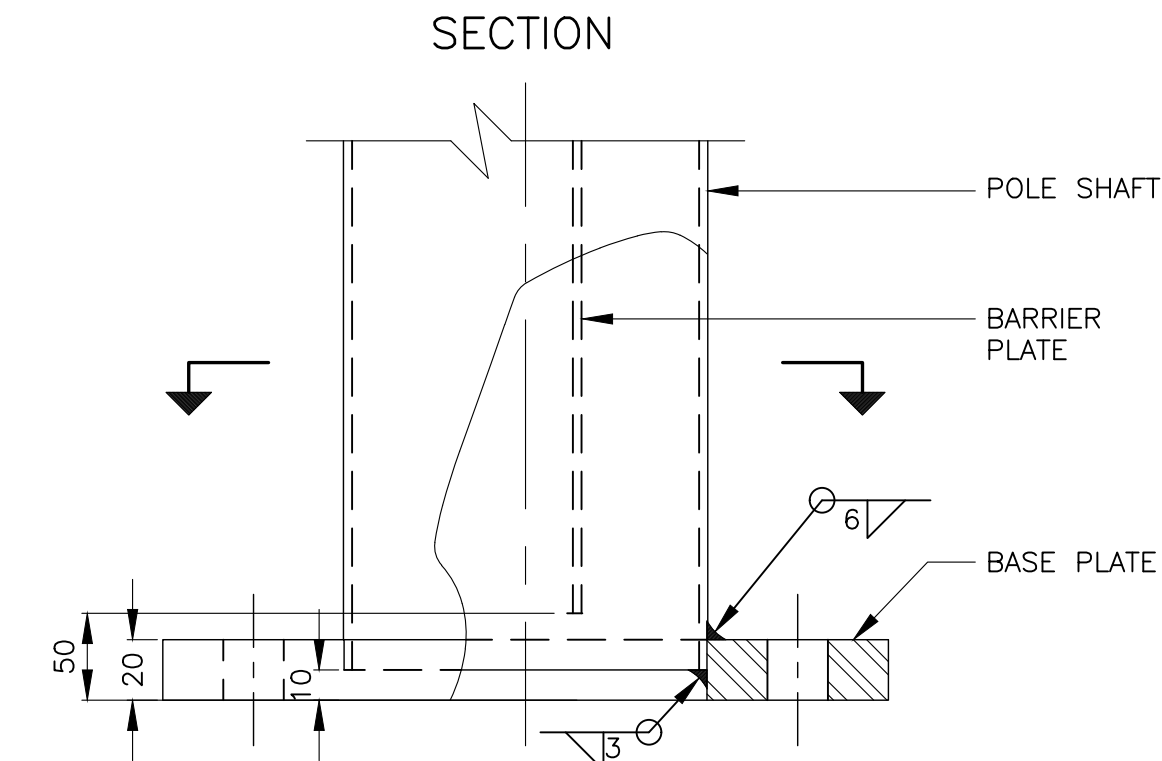
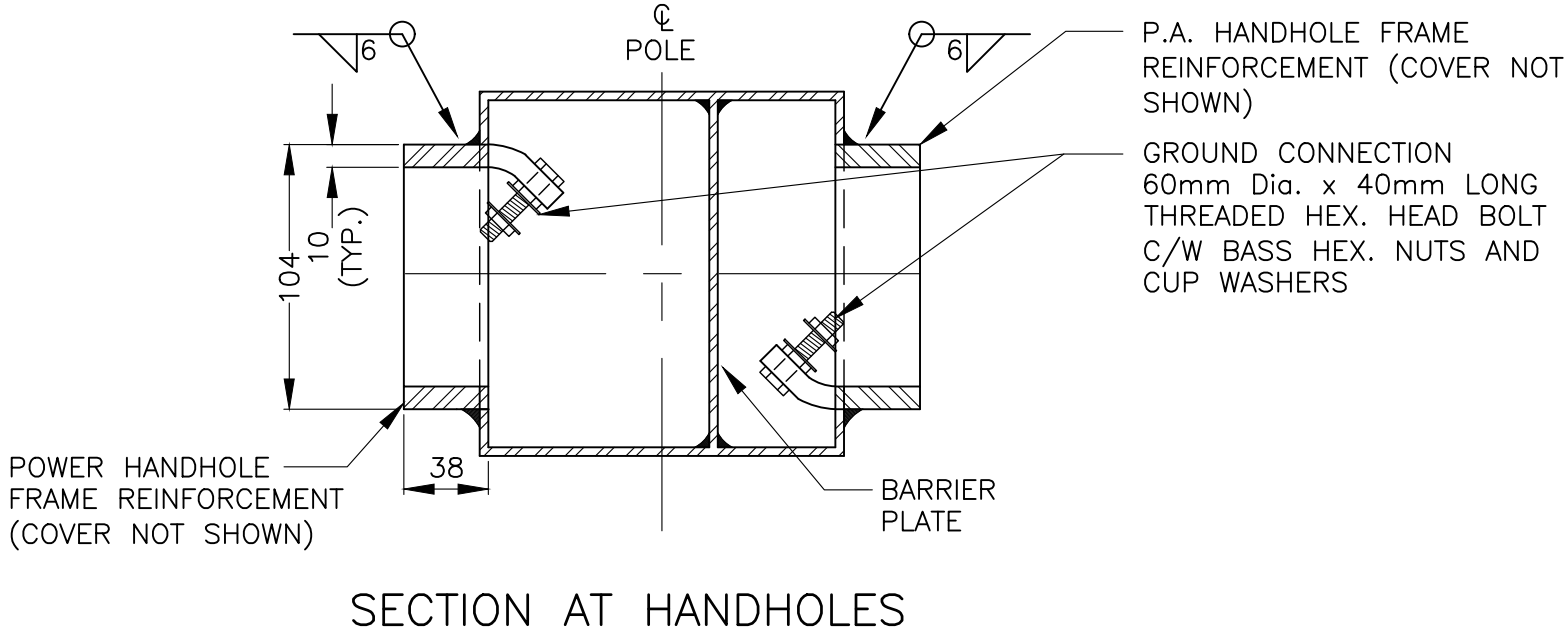


ALL DIMENSIONS SHOWN ARE IN METRES AND/OR MILLIMETRES UNLESS OTHERWISE NOTED.

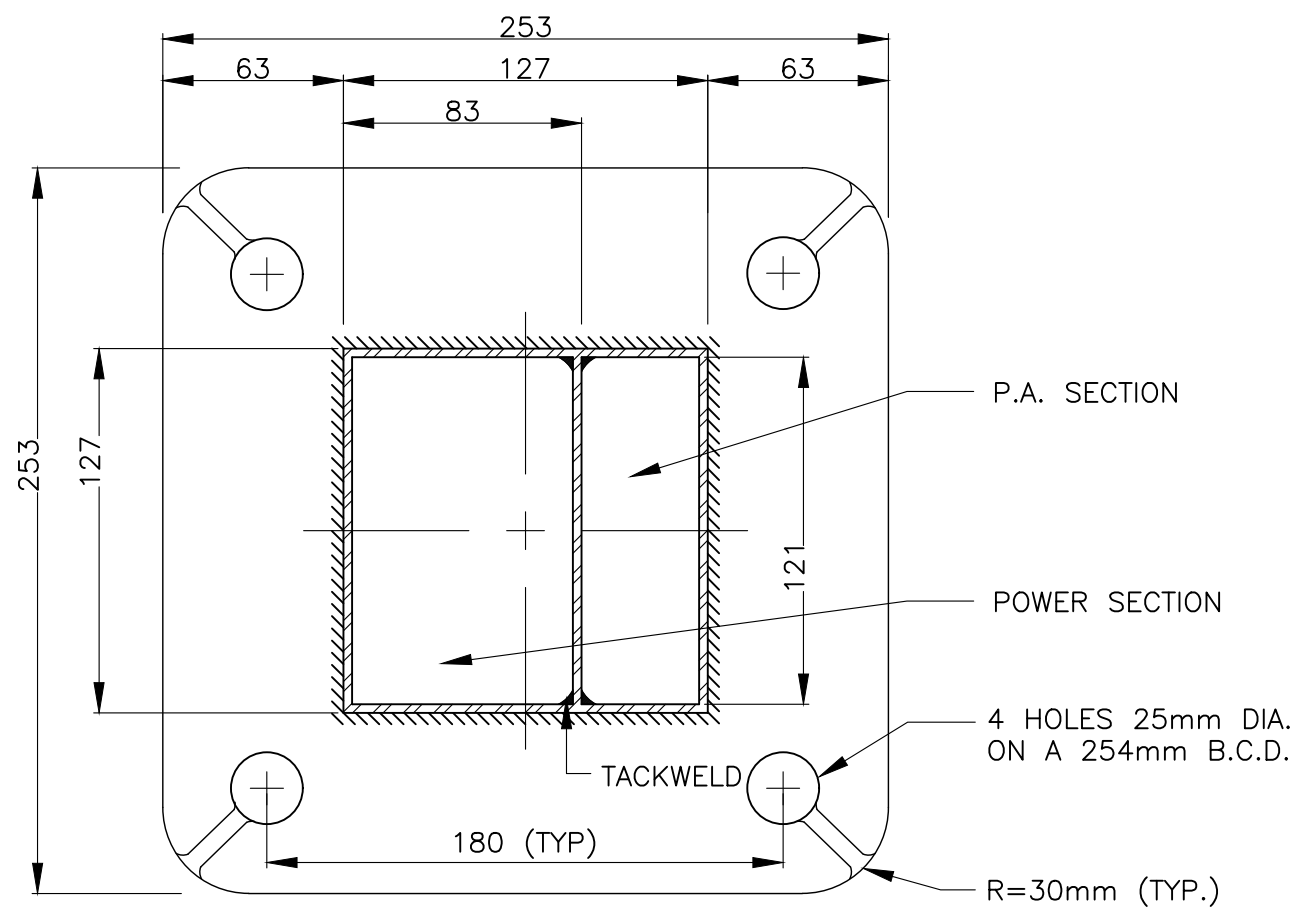


DETAIL 2
BASE PLATE
LS-03-001, LS-03-002, LS-03-004




DETAIL 3
HANDHOLE AND COVER
LS-03-001

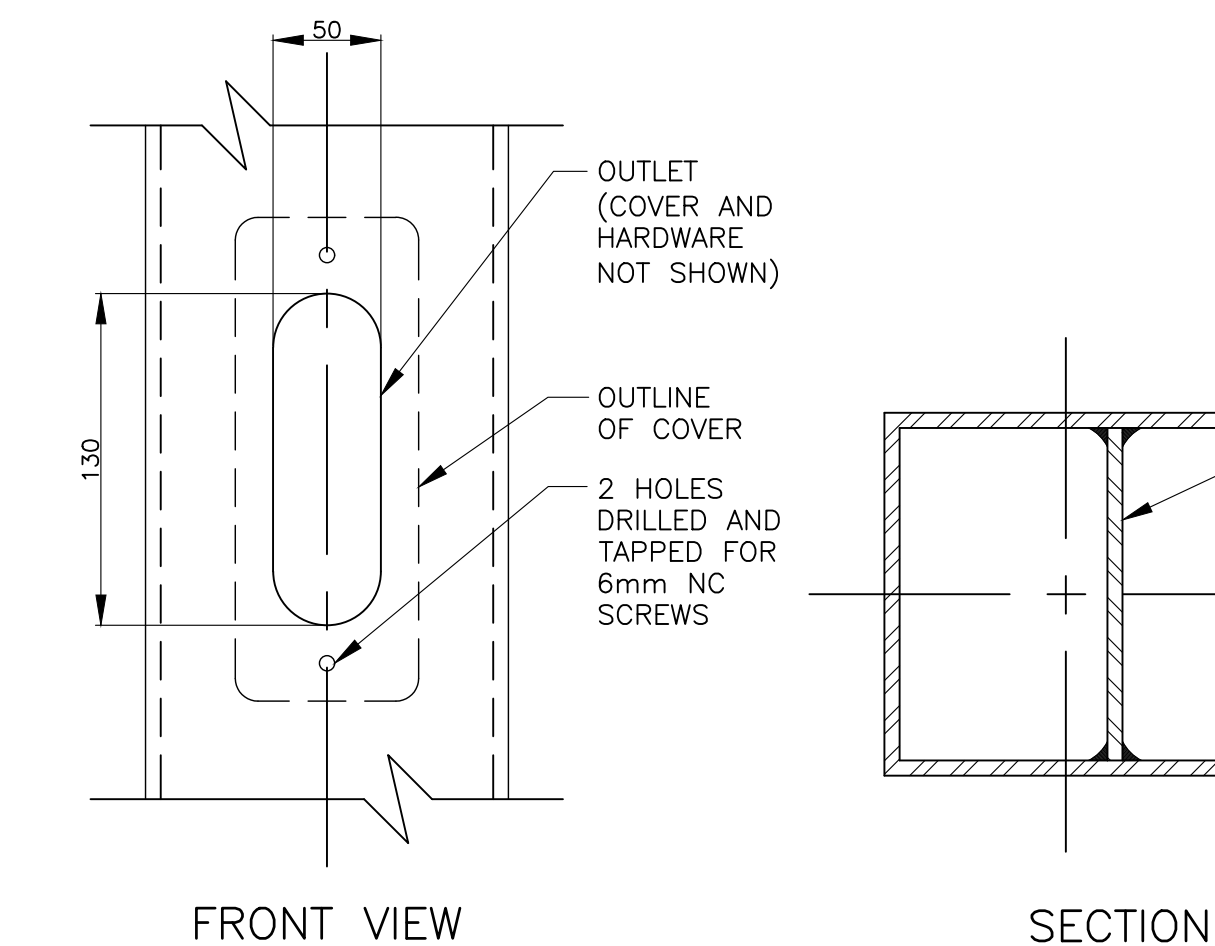

DETAIL 5
COMM. OUTLET
LS-03-001

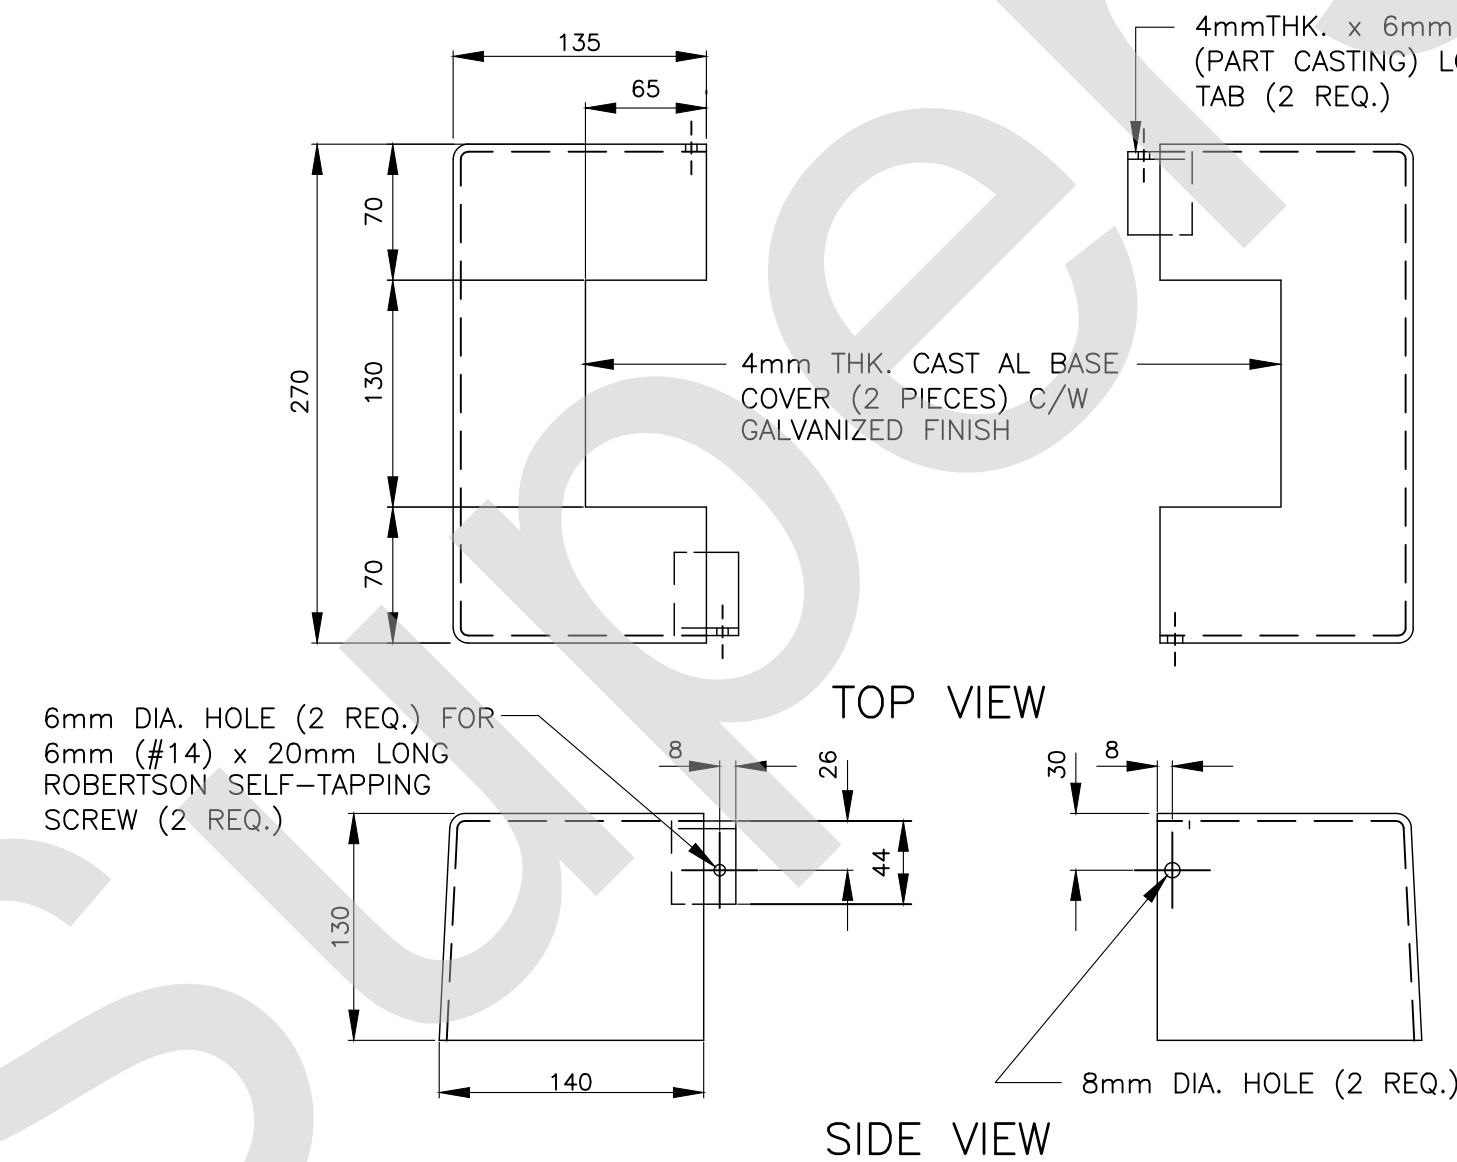

DETAIL 6
FULL BASE COVER
LS-03-001

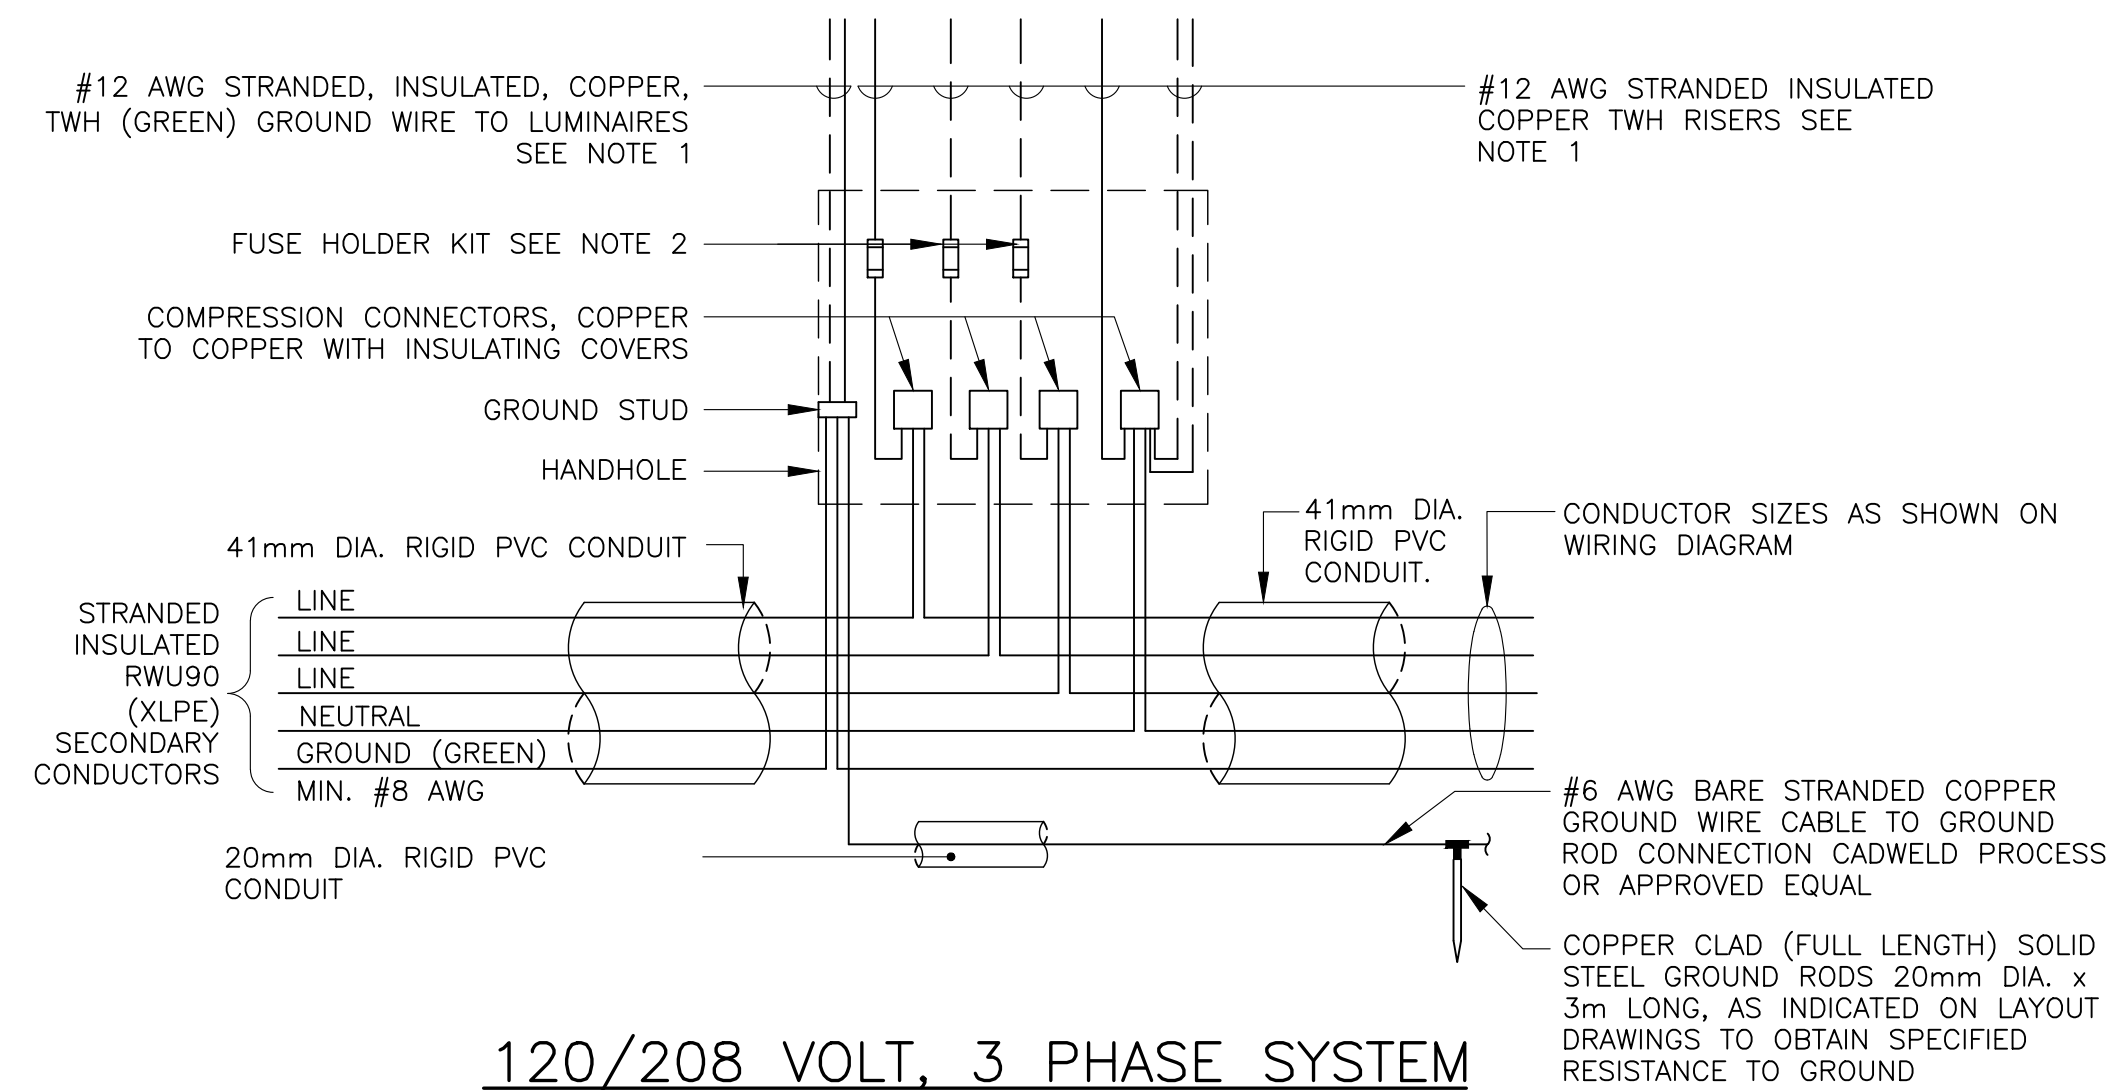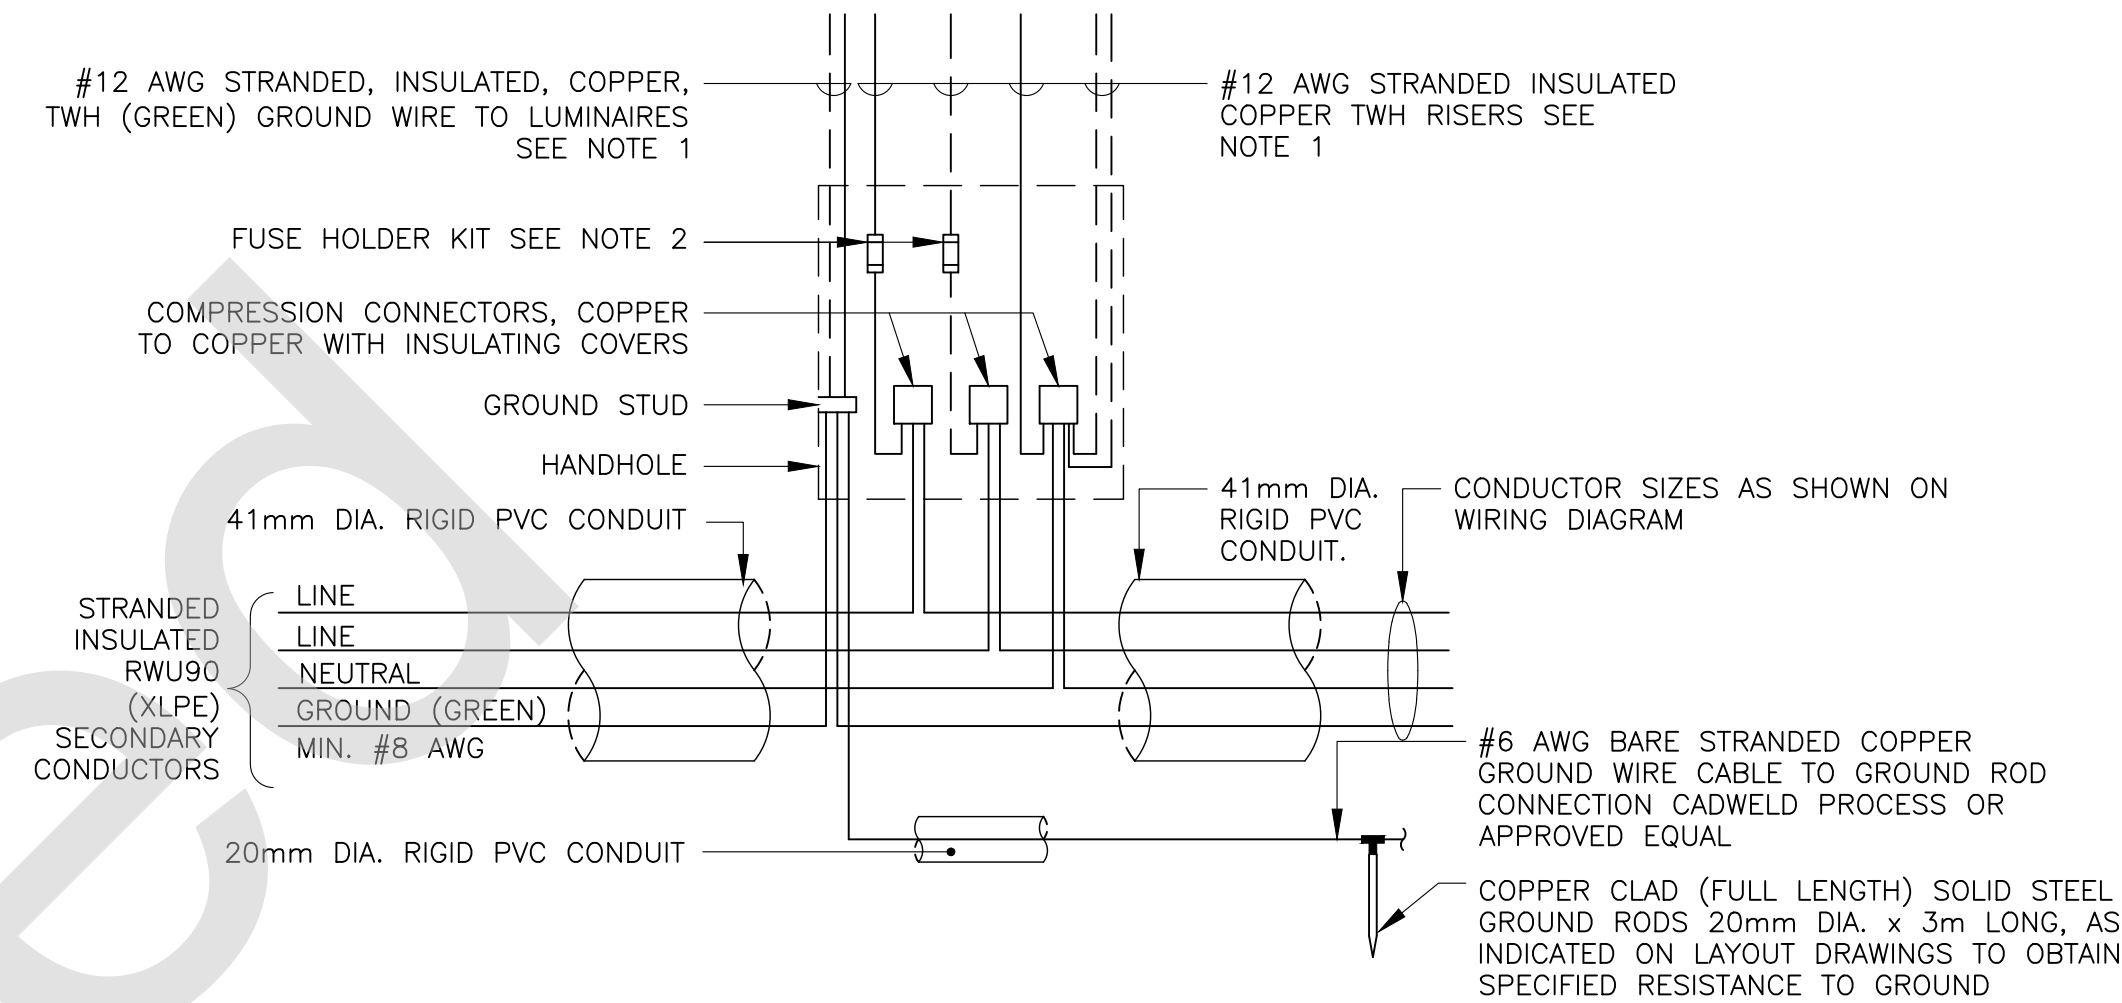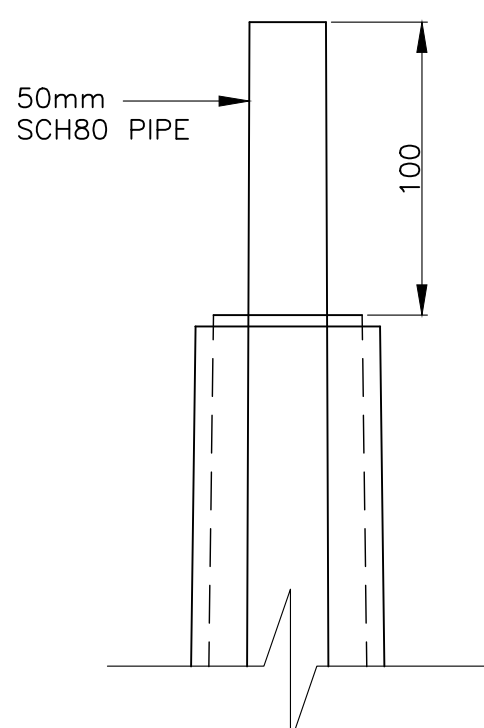


- NOTES:
- BROKEN LINES INDICATE ADDITIONAL CONDUCTORS FOR DOUBLE LUMINAIRE INSTALLATION AND / OR ALTERNATE CIRCUIT IN ACCORDANCE WITH PLATFORM LIGHTING AND WIRING DIAGRAM DRAWINGS.
 - IN-LINE WATERPROOF FUSEHOLDER 600V, 30A WITH BREAKAWAY FEATURE. GOULD GEB-11-11 C/W WATERPROOF INSULATING BOOTS AND ONE 10 AMP FUSE TYPE KTK 600 VOLTS OR APPROVED EQUAL.
 - ALL GROUNDING WIRES TO BE FITTED WITH COMPRESSION LUGS BEFORE SECURING TO GROUND STUD IN POLE.
 - ALL NUTS & BOLTS TO BE STAINLESS STEEL.

NOTE:
THIS DRAWING IS PROVIDED FOR INSTRUCTIONAL DESIGN PURPOSES ONLY BASED ON METROLINX GO TRANSIT DESIGN GUIDELINES AND REQUIREMENTS. THE CONSULTANT SHALL VERIFY FOR LOCAL CODE COMPLIANCE, EXISTING SITE CONDITIONS AND INTER DISCIPLINARY DRAWING COORDINATION. ALL DIMENSIONS AND SPECIFICATIONS SHOULD BE VERIFIED BY CONSULTANT AND/OR CONTRACTOR BEFORE ACTUAL CONSTRUCTION BEGINS.

GO TRANSIT PROJECT NO. XXXXXX

Aug 01/18 8:07pm
AutoCAD drawing: LS_03-002.dwg

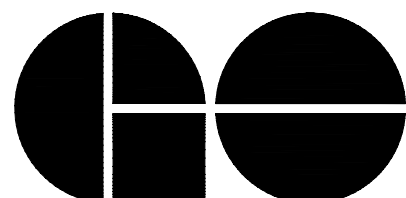REFERENCE DRAWINGS			ISSUE			REVISIONS			DRAWN BY: X.X.X. YY/MM/DD	DESIGNED BY: X.X.X. YY/MM/DD	 A Division of METROLINX	FACILITY			
									CHECKED BY: X.X.X. YY/MM/DD	APPROVED BY: X.X.X. YY/MM/DD		3m LIGHT POLE BASE PLATE, COVERS AND WIRING DETAILS			
						0	18/04/XX		SCALE: N.T.S. FULL SIZE ONLY						
DWG NO.	TITLE		REV.	DATE	ISSUED FOR		REV.	DATE							