



- THIS TYPICAL 6m STRAIGHT SQUARE GALVANIZED STEEL POLE ASSEMBLY IS GENERAL GUIDANCE FOR ELECTRICAL INSTALLATION APPLICABLE TO PLATFORM, BUS LOADING, PUDO AND WALKWAY AREA CCTV. FOR CONCRETE FOUNDATION REQUIREMENT, REFER TO LAYOUT DRAWINGS AND CONCRETE FOUNDATION REINFORCEMENT TABLE ON STANDARD DRAWING LS-06-003.1.
- 2. FOR APPLICABLE CCTV MOUNTING HEIGHTS SEE NOTE 1 ABOVE.
- 3. THE HORIZONTAL AND VERTICAL TRACK CLEARANCES FOR ALL PLATFORM CCTV POLE INSTALLATIONS SHALL COMPLY WITH THE LATEST CANADIAN NATIONAL AND CANADIAN PACIFIC RAILWAYS STANDARD CLEARANCE DIAGRAM. THE DESIGNER TO DETERMINE EXACT DISTANCE AND MUST OBTAIN WRITTEN APPROVALS BEFORE ANY WORK IS
- 4. INTENTIONALLY LEFT BLANK.
- 5. INTENTIONALLY LEFT BLANK.
- 6. COMMUNICATION HARDWARE AND WIRING SUPPLIED AND INSTALLED AS SPECIFIED. FOR EXACT LOCATION OF CAMERA, REFER TO LAYOUT DRAWINGS.
- 7. GROUNDING RODS TO BE LOCATED AT BASE OF EVERY OTHER POLE OR EVERY 50M
- 8. ORIENTATE POLE SUCH THAT HANDHOLES POINT DOWN THE LENGTH OF THE




DETAIL COMM. WIRING OUTLET

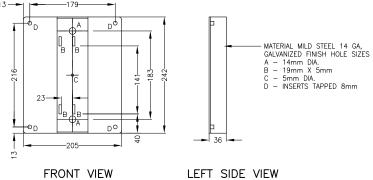

SECTION



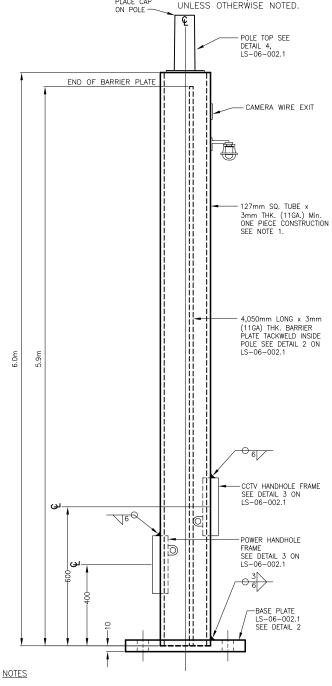

METRIC

ALL DIMENSIONS SHOWN ARE IN METRES AND/OR MILLIMETRES

- 1. ALL WELDING TO CONFORM TO THE SPECIFICATIONS OF THE C.W.B. W47.1 AND W59 FULLY APPROVED C.S.A. QUALITY PROGRAM STANDARD CAN3-2299.3-1979. DESIGNED TO AASHTO WITH 80MPH WIND SPEED & 1.3 GUST FACTOR, DESIGNED FOR MAXIMUM
- 2. ALL FASTENERS TO BE STAINLESS STEEL EXCEPT WHERE NOTED OTHERWISE.
- 3. POLE MANUFACTURER SHALL SUPPLY BOLTS, NUTS AND WASHERS TO TO SUIT DESIGN SPECIFIED IN NOTE 2 ABOVE.



METROLINX PROJECT NO. XXXXXX

	REFERENCE DRAWINGS	1		ISSUE			REVISIONS	DRAWN BY:	DESIGNED BY:
								X.X.X. YY/MM/DD	YY/MM/DD
								CHECKED BY:	APPROVED BY:
								YY/MM/DD	YY/MM/DD
								SCALE: N.T.S.	FULL SIZE ONLY
		01	22/02/18	6m CCTV POLE , ELEVATIONS AND DETAILS					
DWG NO.	TITLE	No.	DATE	ISSUED FOR	REV.	DATE			





ELEVATION AND DETAILS

REV. SHEET

CONTRACT NO. DWG. NO. LS-06-001.1